

# Standard Bidding Document

Tender No. PMU 204/25-26 , Procurement of T&P and Testing Equipment  
(Goods)

National

Single Stage-One Envelope



*April 09, 2026*

*PMU HESCO (Hyderabad Electric Supply Company), Director General Procurement  
Project Management Unit Bungalow # A-1 HESCO Colony Hussainabad, Hyderabad.  
Phone: +92-337-219-2716, Email: dgprocurement@hesco.gov.pk*

# Table of Contents

---

<b>Instructions to Bidders</b> .....	3
<b>Bid Data Sheet</b> .....	23
Bids Data Sheet (BDS) .....	24
Eligibility Criteria .....	28
Evaluation Criteria .....	28
Items/Lots .....	28
Related Services of Goods: .....	31
Items/Lot Specification .....	31
Price Schedule .....	44
<b>General Conditions of Contract</b> .....	47
<b>Special Conditions of Contract</b> .....	58
<b>Bid Securing Declaration</b> .....	64
<b>Contract Form</b> .....	66
<b>Integrity Pact</b> .....	69
<b>Performance Guarantee Form</b> .....	71
<b>Annexure</b> .....	73
Technical Specifications/requirement .....	74
<b>Procurement Forms</b> .....	75
Past Experience and Completed Contracts .....	1
Historical Contract Non-Performance, and Pending Litigation and Litigation History .....	1
Financial Capacity and Net Worth Evaluation Form .....	1

Average Annual Turnover .....	1
<b>Additional Forms and Documents</b> .....	<b>79</b>

## INVITATION TO BIDS PROCUREMENT OF GOODS

1. The **PMU HESCO (Hyderabad Electric Supply Company)** has reserved Funds for the procurement planned for FY **2025-26**. The **PMU HESCO (Hyderabad Electric Supply Company)** intends to apply part of the proceeds of this Fund to cover eligible payments under the contract for the "**Tender No. PMU 204/25-26 , Procurement of T&P and Testing Equipment**".
2. The **PMU HESCO (Hyderabad Electric Supply Company)** invites E-bids from eligible Bidders for procurement of goods described in the bidding documents on **EPADS v2.0**.
3. **Single Stage-One Envelope** will be used by adopting **Least Cost Based Selection (LCBS)** Technique for the subject procurement, in line with the Public Procurement Rules, 2004 and any Regulations, Regulatory Guides, Procurement Guidelines or Instructions issued by the Authority from time to time.
4. All Bids must be accompanied by a Bid Security amounting described in Bid Security Section in Bidding Document in the form of **Pay Order, Banker's Cheque, Call at Deposit, Demand Draft**. Where **Bid Security** is not required by the **Procuring Agency**, Bidders are required to furnish **Bid Security Declaration** as specified in Bidding Document.
5. E-Bidding documents, containing detailed terms & conditions, specifications and requirements etc. are available on **e-Pak Acquisition and Disposal System (EPADS)** at <https://vendors.epads.gov.pk/>.
6. Bidder(s) are required to get themselves registered on **EPADS v2.0** on or before **Monday, May 4, 2026 11:00 AM**. E-bids will be opened using **EPADS v2.0** on the same day at **Monday, May 4, 2026 11:30 AM**. Manual submission of Bids shall not be entertained. Those vendors who have not yet registered on the new version of **EPADS v2.0**, may register themselves on <https://vendors.epads.gov.pk/>. A tutorial to explain the registration process is available at <https://www.youtube.com/watch?v=MNW6T38v7tc>

7. In terms of Rules 48 of Public Procurement Rules, 2004 Grievance Redressal Committee (GRC) is notified for the subject procurement and notification copy is available on the procuring agency's website and on Authority's website at ([www.ppra.org.pk](http://www.ppra.org.pk)).

PMU HESCO (Hyderabad Electric Supply Company), Director General  
Procurement  
Project Management Unit Bungalow # A-1 HESCO Colony Hussainabad,  
Hyderabad.  
+92-337-219-2716  
dgprocurement@hesco.gov.pk





# Instructions to Bidders

## A. Introduction

### 1.Scope of Bids

1.1 The Procuring Agency (PA), as indicated in the **Bids Data Sheet (BDS)** invites Bids **through EPADS v2.0** for the provision of Goods for as specified in the BDS and **in Section V - Evaluation Criteria, Specifications & Schedule of Requirements**. The name, identification, and number of items/deliverables are provided in the **BDS**. The successful Bidders will be expected to provide the goods within the specified period and timeline(s) as stated in the **BDS**.

### 2. Source of Funds

2.1 Source of funds is referred in Clause-1 of Invitation for Bids.

### 3. Eligible Bidders

3.1 A Bidder may be natural person, company or firm or public or semi-public agency of Pakistan or any foreign country, or any combination of them with a formal existing agreement (on Judicial Papers) in the form of a joint venture, consortium, or association. In the case of a joint venture, consortium, or association, all members shall be jointly and severally liable for the execution of the Contract in accordance with the terms and conditions of the Contract. The joint venture, consortium, or association shall nominate a Lead Member as nominated in the BDS, who shall have the authority to conduct all business for and on behalf of any and all the members of the joint venture, consortium, or association during the Bidding process, and in case of award of contract, during the execution of the contract.

3.2 Verifiable copy of the agreement that forms a joint venture, consortium or association shall be required to be submitted as part of the Bid.

3.3 The appointment of Lead Member in the joint venture, consortium, or association shall be confirmed by submission of a valid Power of Attorney to the Procuring Agency.

3.4 Any bid submitted by the joint venture, consortium or association shall indicate the part of proposed contract to be performed by each party and each party shall be evaluated (or post qualified if required) with respect to its contribution only, and the responsibilities of each party shall not be substantially altered without prior written approval of the Procuring Agency and in line with

any instructions issued by the Authority.

*(The limit on the number of members of JV or Consortium or Association may be prescribed in BDS, in accordance with the guidelines issued by the PPRA).*

3.5 The invitation for Bids is open to all prospective suppliers, manufacturers, or authorized agents / dealers subject to any provisions of incorporation or licensing by the respective national incorporating agency or statutory body established for that particular trade or business. Procuring agencies shall specify the registration/licensing requirements for the foreign bidders keeping in view the requirement of that business.

3.6 A Bidder shall not have a conflict of interest. All Bidders found to have a conflict of interest shall be disqualified. A Bidder may be considered to have a conflict of interest with one or more parties in this Bidding process, if they:

1. are associated or have been associated in the past, directly or indirectly with a firm or any of its affiliates which have been engaged by the Procuring Agency to provide consulting services for the preparation of the design, specifications and other documents to be used for the procurement of the Goods to be purchased under this Invitation for Bids.
2. have controlling shareholders in common; or
3. receive or have received any direct or indirect subsidy from any of them; or
4. have the same legal representative for purposes of this Bid; or
5. have a relationship with each other, directly or through common third parties, that puts them in a position to have access to information about or influence on the Bids of another Bidder, or influence the decisions of the Procuring Agency regarding this Bidding process; or
6. Submit more than one Bid in this Bidding process.

3.7 A Bidder may be ineligible if –

1. he is declared bankrupt or, in the case of company or firm, insolvent;
2. payments in favor of the Bidder is suspended in accordance with the judgment of a court of law other than a judgment declaring bankruptcy and resulting (in accordance with the national laws) in the total or partial loss of the right to administer and dispose of its property;

3. the Bidder is convicted, by a final judgment, of any offence involving professional conduct;

4. the Bidder is blacklisted locally or by international organizations and hence debarred due to involvement in corrupt and fraudulent practices, or performance failure or due to breach of Bid securing declaration.

3.8 As and when required, bidders shall provide to the Procuring Agency evidence of their eligibility, proof of compliance with the necessary legal requirements to carry out the contract effectively.

3.9 Bidders shall submit Bids relating to the nature, conditions and modalities of sub-contracting wherever the sub-contracting of any elements of the contract amounting to more than ten (10) percent of the Bid price is envisaged.

## 4. Eligible Goods and Related Services

4.1 All goods and related services to be supplied under the contract shall have their origin in eligible source countries, and all expenditures made under the contract will be limited to such goods and services. For purpose of this Bid, ineligible countries are the countries declared ineligible by the Federal Government.

## 5. One Bid per Bidder

5.1 A bidder shall submit only one Bid, in the same bidding process, either individually as a Bidder or as a member in a joint venture or any similar arrangement.

5.2 The Bidder shall not engage a subcontractor for any portion of the contract if the value of such subcontracting exceeds thirty percent (30%) of the total contract amount.

## 6. Cost of Bidding

6.1 Any cost incurred by the bidder relating to the preparation and submission of its Bid shall be borne by the bidder, and the Procuring Agency shall in no case be responsible or liable for those costs, regardless of the conduct or outcome of the bidding process.

## B. Bidding Documents

## 7. Contents of Bidding Document

7.1 The Goods required, Bidding procedures, and terms and conditions of the contract are prescribed in the Bidding Documents. In addition to the Invitation for Bids, the Bidding documents which should be read in conjunction with any addenda issued in accordance with **ITB 9.1** include:

**Section I** -Invitation to Bids

**Section II** Instructions to Bidders (ITB)

**Section III** Bid Data Sheet (BDS)

**Section IV** Evaluation Criteria, Specifications, Schedule of Requirements

**Section V** Bid Forms

**Section VI** General Conditions of Contract (GCC)

**Section VII** Special Conditions of Contract (SCC)

**Section VIII** Contract Forms

7.2 The Bidder is expected to examine all instructions, forms, terms and specifications in the Bidding documents. Failure to furnish all the information required in the Bidding documents through **EPADS v2.0** will be at the Bidder's risk and may result in the rejection of his Bids.

## 8. Clarification of Bidding documents

8.1 A prospective Bidder requiring any clarification of the Bidding documents may notify the Procuring Agency through **EPADS v2.0**.

8.2 The Procuring Agency will within three (3) working days after receiving the request for clarification, respond to any request for clarification through **EPADS v2.0** provided that such request is received not later than three (03) days prior to the deadline for the submission of Bids as prescribed in **ITB 22**

8.3 Copies of the Procuring Agency's response will be forwarded to all identified Prospective Bidders through **EPADS v2.0**, including a description of the inquiry, but without identifying its source.

8.4 Should the Procuring Agency deem it necessary to amend the Bidding document as a result of a clarification, it shall do so following the procedure under **ITB 9**.

8.5 If indicated **in the BDS**, the Bidder's designated representative is invited at the Bidder's cost to attend a pre-Bid meeting at the place, date and time mentioned **in the BDS**. During this pre-Bid meeting, prospective Bidders may request clarification of the schedule of requirement, the Evaluation Criteria or any other aspects of the Bidding document.

8.6 Minutes of the pre-Bid meeting, if applicable, including the text of the questions asked by Bidders, including those during the meeting (without identifying the source) and the responses given, together with any responses prepared after the meeting will be uploaded on **EPADS v2.0**. Any modification to the Bidding documents that may become necessary as a result of the pre-Bid meeting shall be made by the Procuring Agency exclusively through the use of an Addendum pursuant to **ITB 9**. Non-attendance at the pre-Bid meeting will not be a cause for disqualification of a Bidder.

## 9. Amendment of Bidding documents

9.1 Before the deadline for submission of Bids, the Procuring Agency for any reason, whether at its own initiative or in response to a clarification requested by a prospective Bidder or Pre-Bid meeting may modify the Bidding documents by issuing addenda through **EPADS v2.0**.

9.2 The Procuring Agency shall promptly publish the addendum through **EPADS v2.0**.

9.3 Any addendum issued including the notice of any extension of the deadline shall also be communicated through EPADS v2.0 to all the bidders who have already submitted their bids. Such bidders shall have the right to withdraw their already submitted bid and re-submit the revised bid prior to the original or extended bid submission deadline.

9.4 To give prospective Bidders reasonable time in which to take an addendum/corrigendum into account in preparing their Bids, the Procuring Agency may, at its discretion, extend the deadline for the submission of Bids through **EPADS v2.0**:

Provided that the Procuring Agency shall extend the deadline for submission of Bids, if such an addendum is issued within last three (03) days of the Bids submission deadline.

## C. Preparation of Bids

## 10. Language of Bid

10.1 The Bid prepared by the bidder, as well as all correspondence and documents relating to the Bids exchanged by the Bidder and the Procuring Agency shall be written in the English language unless otherwise specified in the BDS. Supporting documents and printed literature furnished by the Bidder may be in another language provided they are accompanied by an accurate translation of the relevant pages in the English language unless otherwise specified in the **BDS**, in which case, for purposes of interpretation of the Bidder, the translation shall govern.

## 11. Documents and samples Constituting the Bid

**11.1 The Bid prepared by the Bidder shall constitute** the documents required in the **BDS**.

Details of sample(s) where applicable and requested in the BDS.

1. Documentary evidence established in accordance with ITB that the Bidder is eligible and/or qualified for the subject bidding process;
2. Documentary evidence establish that the Bidder has been authorized by the manufacturer to deliver the goods into Pakistan, where required and where the supplier is not the manufacturer of those goods;
3. Documentary evidence establish that the goods and related services to be supplied by the Bidder are eligible goods and services, and conform to the Bidding Documents;
4. Bid security or Bid Securing Declaration furnished in accordance with **ITB 18**.

## 12. Documents Establishing Eligibility of the Goods and Conformity to Bidding documents

**12.1** To establish the conformity of the bidder to the Bidding document, the Bidder shall furnish as part of its Bids the documentary evidence that Goods provided conform to the technical specifications and standards.

## 13. Documents Establishing Eligibility and Qualification of the Bidder

**13.1** The Bidder shall furnish, as part of its Bid, all those documents establishing the Bidder's eligibility to participate in the Bidding process and/or its qualification to perform the contract if its Bid is accepted.

## 14. Form of Bids

**14.1** The Bidder shall fill the Form of Bid furnished in the Bidding documents. The Bids Form must be completed without any alterations to its format and no substitute shall be accepted.

## 15. Bids Prices

15.1 The Bids Prices quoted by the Bidder in the Form of Bid and in the Price Schedules shall conform to the requirements specified below or exclusively mentioned hereafter in the Bidding documents.

15.2 All items in the Schedule of Requirement must be listed and priced separately in the Price Schedule(s). If a Price Schedule shows items listed but not priced and neither explicitly denied, their prices shall be construed to be included in the prices of other items.

15.3 Items not listed in the Price Schedule shall be assumed not to be included in the Bid, and provided that the Bid is still substantially responsive in their absence or due to their nominal nature, the corresponding average price of the respective item(s) of the remaining substantially responsive Bidder(s) shall be construed to be the price of those missing item(s).

15.4 The Bid price to be quoted in the Form of Bid in accordance with **ITB 14.1** shall be the total price of the Bid.

15.5 The Bidder shall indicate on the appropriate Price Schedule, the unit prices (where applicable) and total Bid price of the Goods it proposes to provide under the contract.

15.6 Prices quoted by the Bidder shall be fixed during the Bidder's performance of the contract and not subject to variation on any account. A Bid submitted with an adjustable price will be treated as non-responsive and shall be rejected.

## 16. Bids Currencies

16.1 Prices shall be quoted in Pakistani Rupees unless otherwise specified in the BDS in accordance with Rule 30(2) of the Public Procurement Rules, 2004.

## 17. Bids Validity Period

17.1 Bids shall remain valid for the period specified in the **BDS** after the Bid submission deadline prescribed by the Procuring Agency. A Bid valid for a shorter period shall be rejected by the Procuring Agency as non-responsive. The period of Bid validity will be determined from the complementary Bid securing instrument, i.e. the expiry period of Bid Security or Bids Securing Declaration as the case may be.

17.2 The procuring agency shall ordinarily be under an obligation to process and evaluate the bid and to issue letter of award within the stipulated bid validity period.

17.3 Under exceptional circumstances, prior to the expiration of the initial Bid validity period, the Procuring Agency may request the Bidders' consent to an extension of the period of validity of their Bids only once through **EPADS v2.0**, for the period not more than the period of initial bid validity. The Bid Security provided under **ITB 18** shall also be suitably extended. A Bidder may refuse the request without forfeiting its Bid security or causing to be executed its Bid Securing Declaration. A Bidder agreeing to the request will not be required nor permitted to modify its Bid, but will be required to extend the validity of its Bid Security or Bid Securing Declaration for the period of the extension.

## 18. Bid Security or Bid Securing Declaration

18.1 The Bidder shall furnish as part of its Bid, a Bid Security in accordance with Rule 25 of the Public Procurement Rules, 2004.

18.2 The original Bid Security shall be enclosed within the sealed envelope and to be submitted physically before closing time for submission of bids. Whereas, scanned copy of bid security shall be uploaded electronically through EPADS v2.0 before closing hours for submission of bids.

18.3 The Bidder who failed to submit the original Bids security before the submission deadline shall be disqualified straightaway.

18.4 The Bid Security or Bid Securing Declaration is required to protect the Procuring Agency against the risk of Bidder's conduct which would warrant the security's forfeiture, pursuant to **ITB 18.7**.

18.5 The Bid Security shall be denominated in the local currency, and it shall be a Bank Draft in the name of the Procuring Agency and valid for twenty-eight (28) days beyond the end of the validity of the Bid. This shall also apply if the period

for Bids/Bid Validity is extended. In either case, the form must include the complete name of the Bidder.

18.6 The Bid Security shall be payable promptly upon written demand by the Procuring Agency in case any of the conditions listed in **ITB 18** are invoked.

18.7 Unsuccessful Bidders' Bid Security will be discharged or returned as promptly as possible, however in no case later than thirty (30) days after the expiration of the period of Bids Validity prescribed by the Procuring Agency pursuant to **ITB 17**. The Procuring Agency shall make no claim to the amount of the Bid Security, and shall promptly return the Bid Security document, after whichever of the following that occurs earliest:

1. the expiry of the Bid Security;
2. the entry into force of a procurement contract and the provision of a Performance Guarantee, for the performance of the contract if such a guarantee, is required by the Bid documents;
3. the rejection by the Procuring Agency of all Bids;
4. the withdrawal of the Bids prior to the deadline for the submission of Bids, unless the Bids documents stipulate that no such withdrawal is permitted.

18.8 The successful Bidder's Bids Security will be discharged upon the Bidder signing the contract, or furnishing the Performance Guarantee.

18.9 The Bid Security may be forfeited or the Bid Securing Declaration executed:

1. if a Bidder:
  2. withdraws its Bid during the period of Bid Validity as specified by the Procuring Agency, and referred by the Bidder on the Form of Bids except as provided for in **ITB 17.2**; or
  3. does not accept the correction of errors; or
  4. in the case of a successful Bidder, if the Bidder fails:
    5. to sign the contract; or
    6. to furnish Performance Guarantee.

## 19. Withdrawal, Substitution, and Modification of Bid

19.1 Before Bid submission deadline, any Bidder may withdraw, substitute, or modify its Bid after it has been submitted through EPADS v2.0. Bids requested to be withdrawn, shall be returned unopened to the Bidders through **EPADS v2.0**.

## 20. Format and Signing of Bid

20.1 The Bidder shall prepare and submit Bids with due diligence after carefully reading all the terms and condition **before bid submission deadline** through EPADS v2.0.

## D. Submission of Bids

### 21. Submission of Bids through EPADS v2.0

21.1 The Technical and Financial Bids if required to submitted, shall be submitted on **EPADS v2.0**.

### 22. Deadline for Submission of Bids

22.1 Bids shall be received by the Procuring Agency through **EPADS v2.0** before bid submission deadline.

22.2 The Procuring Agency may, under exceptional circumstances, extend the deadline for the submission of Bids, after recording reasons in writing and in an equal opportunity manner.

In such case, all rights and obligations of the Procuring Agency and the Bidders that were previously governed by the original deadline shall thereafter be subject to the revised deadline.

## E. Opening and Evaluation of Bids

### 23. Opening of Bids

23.1 The Bid Evaluation Committee of the Procuring Agency shall open all Bids through the EPADS v2.0, on the date and time specified in the Bid Data Sheet (BDS).

23.2 The Bid Evaluation Committee **shall generate minutes through EPADS v2.0 containing brief details of bid opening process.** The record of the Bid opening shall include, as a minimum: the name of the Bidder, the Bid price if applicable, and the presence or absence of a Bid Security or Bid Securing Declaration.

23.3 The procuring agency shall live broadcast the opening of bids on national media or on their website or digital channels, if the volume of procurement exceeds five hundred million rupees in case of goods and services and one thousand million rupees in case of works.

23.4 In case the date of opening of bid has been declared as public holiday or the procuring agency fail to open bid due to any EPADS v2.0 related issues, the submission and opening of bids shall be shifted to the next working day on the same time.

23.5 In case of Single Stage One Envelope Procedure, the Bidders names, the Bid prices, the total amount of each Bid and, the presence or absence of Bid Security, Bid Securing Declaration and such other details as the Procuring Agency may consider appropriate, will be announced by the Bid Evaluation Committee.

## 24. Clarification of Bids

24.1 To assist in the examination, evaluation and comparison of Bids of the Bidders, the Procuring Agency may, ask any Bidder for a clarification of its Bid including breakdown of prices.

24.2 The request for clarification and the response shall be sought through EPADS v2.0 **before three days prior to the deadline for submission of bids.** No change in the prices or substance of the Bids shall be sought, offered, or permitted.

24.3 The alteration or modification in the BIDS which in any way affect the following parameters will be considered as a change in the substance of a Bids:

1. evaluation & qualification criteria;
2. required scope of work or specifications;
3. all securities requirements;
4. tax requirements;

5. terms and conditions of Bidding documents.

6. change in the ranking of the Bidder

24.4 From the time of Bids opening to the time of Contract award if any Bidder wishes to contact the Procuring Agency on any matter related to the Bids it should do so through **EPADS v2.0**.

## 25. Preliminary Examination of Bids

25.1 Prior to the detailed evaluation of Bids, the Procuring Agency will determine whether each Bid:

1. meets the eligibility criteria defined in **ITB 3**;
2. has been prepared as per the format and contents defined by the Procuring Agency in the Bidding documents;
3. is accompanied by the required securities; and
4. is substantially responsive to the requirements of the Bidding documents.

25.2 The Procuring Agency's determination of a Bid's responsiveness will be based on the contents of the Bid itself.

25.3A substantially responsive Bid is one which conforms to all the terms, conditions, and specifications of the Bidding documents, without material deviation or reservation. A material deviation or reservation is one that: -

1. affects in any substantial way the scope, quality, or performance of the Goods;
2. limits in any substantial way, inconsistent with the Bidding documents, the Procuring Agency's rights or the Bidders obligations under the Contract; or
3. if rectified, would affect unfairly the competitive position of other Bidders presenting substantially responsive Bids.

25.3 If a Bids is not substantially responsive, it will be rejected by the Procuring Agency and may not subsequently be evaluated for complete technical responsiveness.

## 26. Examination of Terms and Conditions; Technical Evaluation

26.1 The Procuring Agency shall examine the Bids to confirm that all terms and conditions specified in the **GCC** and the **SCC** have been accepted by the Bidder without any material deviation or reservation.

26.2 The Procuring Agency shall evaluate the technical aspects of the Bids submitted, to confirm that all requirements specified in Schedule of Requirements and Technical Specifications of the Bidding documents have been met without material deviation or reservation.

26.3 If after the examination of the terms and conditions and the technical evaluation, the Procuring Agency determines that the Bid is not substantially responsive in accordance with **ITB 25.2**, it shall reject the Bid.

## 27. Correction of Errors

27.1 Bids determined to be substantially responsive will be checked for any arithmetic errors. Errors will be corrected as follows: -

1. if there is a discrepancy between unit prices and the total price that is obtained by multiplying the unit price and quantity, the unit price shall prevail, and the total price shall be corrected, unless in the opinion of the Procuring Agency there is an obvious misplacement of the decimal point in the unit price, in which the total price as quoted shall govern and the unit price shall be corrected;
2. if there is an error in a total corresponding to the addition or subtraction of sub-totals, the sub-totals shall prevail and the total shall be corrected; and
3. where there is a discrepancy between the amounts in figures and in words, the amount in words will govern.
4. Where there is discrepancy between grand total of price schedule and amount mentioned on the Form of Bids, the amount referred in Price Schedule shall be treated as correct subject to elimination of other errors.

27.2 The amount stated in the Bid will, be adjusted by the Procuring Agency in accordance with the above procedure for the correction of errors and, with the concurrence of the Bidder, shall be considered as binding upon the Bidder. If the Bidder does not accept the corrected amount, its Bid will then be rejected, and the Bid Security may be forfeited or the Bids Securing Declaration may be executed.

## 28. Conversion to Single Currency

28.1 To facilitate evaluation and comparison, the Procuring Agency will convert all Bids prices expressed in the amounts in various currencies in which the Bids prices are payable. For the purposes of comparison of bids quoted in different currencies, the price shall be converted into a single currency specified in the bidding documents. The rate of exchange shall be the selling rate prevailing on the date of opening of financial bids specified in the bidding documents, in accordance with weighted average customer exchange rates list issued by the State Bank of Pakistan on that day.

## 29. Evaluation of Bids

29.1 The Bids, quotations, or proposals shall be evaluated by the respective evaluation committees as per evaluation criteria described in the Bidding Documents in accordance with Rule 29 and 30 of the Public Procurement Rules, 2004.

### **1. Least Cost Based Selection (LCBS)**

After meeting the requirements of eligibility, qualification and substantial responsiveness, the bid in compliance with all the mandatory (technical) specifications/requirements and/or requisite quality threshold (if any), and having lowest evaluated cost (or financial proposal) shall be considered Successful Bid.

### **2. Quality and Cost Based Selection (QCBS)**

In such combination, there shall be some specific weightage of both the technical features and financial aspects of the proposal. The financial marks shall be awarded on the basis of inverse proportion calculations. The successful bid shall be declared, on the basis of combined evaluation.

### **3. Quality Based Selection (QBS)**

After meeting the requirements of eligibility, qualification and substantial responsiveness the bid in compliance with all the mandatory (technical) specifications/requirements and attaining highest marks in the Technical Evaluation considering all other qualitative and/or quantitative parameters (or point rated criteria) for technical proposal(s) such as working methodology, implementation plan, resource allocation, additional functionalities, risk management approach, knowledge transfer techniques, post implementation methodology etc. shall be treated as highest ranked bid. Later on, the financial proposal of highest ranked bidder shall be opened, however, in case of failure to proceed further with such a bidder, the procuring agency may resort to second

highest bidder and so on.

29.2 In case of tie of bids, the bidders shall be provided an opportunity to offer their best and final monetary offer through EPADS v2.0. However, in no case the rates shall be higher than the original financial bids.

## 30. Domestic Preference

30.1 The procuring agency shall evaluate and compare bids, allow for preference to domestic bidders, while competing with the international bidders in accordance with the policies of Federal Government.

The percentage of preference, to be accorded shall be clearly mentioned in the bidding documents under the bid evaluation criteria.

## 31. Determination of Successful Bid

31.1 Selection technique will be adopted for determining the Successful Bid in accordance with the criteria referred in the BDS or prescribed in the separate section titled as Evaluation Criteria.

31.2 In case where the Procuring Agency adopts the Cost Based Evaluation Technique and, the Bid with the lowest evaluated price from amongst those which are eligible, compliant and substantially responsive shall be the Successful Bid.

31.3 The Procuring Agency may adopt the Quality & Cost Based Selection Technique due to the following two reasons:

1. Where the Procuring Agency knows about the main features, usage and output of the products; however not clear about the complete features, technical specifications and functionalities of the goods to be procured and requires the bidders to submit their proposals defining those features, specifications and functionalities; or
2. Where the Procuring Agency, in addition to the mandatory requirements and mandatory technical specifications, requires parameters specified in EvaluationCriteria to be evaluated while determining the quality of the goods.

31.4 In such cases, the Procuring Agency may allocate certain weightage to these factors as a part of Evaluation Criteria, and may determine the ranking of the bidders on the basis of combined evaluation in accordance with provisions of Rule 2(1)(h) of the Public Procurement Rules, 2004.

## 32. Abnormally Low Financial Bids

32.1 Where the Bid price is considered to be abnormally low, the Procuring Agency shall perform price analysis either during determination of Successful Bids or as a part of the post-qualification process.

32.2 The Procuring Agency may reject an Abnormally low financial bids.

32.3 In order to identify the Abnormally Low Bids (ALB) following approaches can be considered to minimize the scope of subjectivity:

1. Comparing the Bids price with the cost estimate;
2. Comparing the Bids price with the Bids offered by other Bidders submitting substantially responsive Bids; and
3. Comparing the Bids price with prices paid in similar contracts in the recent past either government- or development partner-funded.

32.4 The Procuring Agency will determine to its satisfaction whether the Bidder that is selected as having submitted the successful bid is qualified to perform the contract satisfactorily.

32.5 The determination will take into account the Bidder's financial, technical, and production capabilities. It will be based upon an examination of the documentary evidence of the Bidder's qualifications submitted by the Bidder, as well as such other information as the Procuring Agency deems necessary and appropriate. Factors not included in these Bidding documents shall not be used in the evaluation of the Bidders' qualifications.

32.6 Procuring Agency may seek "Certificate for Independent Price Determination" from the Bidder and the results of reference checks may be used in determining an award of contract.

Explanation: The Certificate shall be furnished by the Bidder. The Bidder shall certify that the price is determined keeping in view of all the essential aspects such as raw material, its processing, value addition, optimization of resources due to economy of scale, transportation, insurance and margin of profit etc.

32.7 An affirmative determination will be a prerequisite for award of the contract to the Bidder. A negative determination will result in rejection of the Bidder's Bids, in which event the Procuring Agency will proceed to the next ranked Bidder to make a similar determination of that Bidder's capabilities to perform

satisfactorily.

## F. Award of Contract

### 33. Criteria of Award

33.1 The Procuring Agency will award the Contract to the Bidder whose Bids has been determined to be substantially responsive to the Bidding documents and who has been declared as Most Advantageous Bidder.

### 34. Negotiations

34.1 The procuring agency shall not engage in negotiations with respect to scope and price with the bidder except when the procuring agency conducts a procurement using direct **or negotiated** contracting or a request for proposals with evaluation based on quality alone.

34.2 The procuring agency may negotiate with the most advantageous bid with a view to streamline the work or task execution, at the time of contract finalization on methodology, work plan, staffing, finalizing payment arrangements, delivery arrangements, minor amendments to the special conditions of the contract.

### 35. Procuring Agency Right to reject all bids

35.1 The Procuring Agency reserves the right to reject all bids or proposals at any time prior to the issuance of the Letter of Award, without incurring any liability, in accordance with Rule 33 of the Public Procurement Rules, 2004.

### 36. Procuring Agency's Right to Vary Quantities at the Time of Award

36.1 The Procuring Agency reserves the right at the time of contract award to increase or decrease the **quantity of** Goods originally specified in these Bidding documents provided this does not exceed **by** 15%, without any change in unit price or other terms and conditions of the Bids and Bidding documents.

### 37. Notification of Award

37.1 Prior to the award of contract, the procuring agency shall announce and publish the result of bid evaluation on **EPADS v2.0** in accordance with Rule 35

of the Public Procurement Rules, 2004.

37.2 The Bidder whose Bids has been accepted will be notified of the award by the Procuring Agency prior to expiration of the Bids/Bid Validity period. The Letter of Award will state the sum that the Procuring Agency will pay the successful Bidder in consideration for the delivery of Goods as prescribed by the Contract (hereinafter and in the Contract called the "Contract Price).

37.3 The Letter of award will constitute the formation of the Contract, subject to the Bidder furnishing the Performance Guarantee and signing of the contract.

## 38. Signing of Contract

38.1 Promptly after issuance of Letter of award, Procuring Agency shall send the successful Bidder the draft Contract, incorporating all terms and conditions as agreed by the parties to the contract.

38.2 Immediately after the Redressal of grievance by the GRC (if any), mandatory standstill period in accordance with Rule 35 of the Public Procurement Rules, 2004 and **after fulfillment of all condition's precedent** of the Contract Form, the successful Bidder and the Procuring Agency shall sign the Contract.

## 39. Corrupt & Fraudulent Practices

39.1 Procuring Agencies (including beneficiaries of Government funded projects and procurement) as well as Bidders/Contractors under Government financed contracts, observe the highest standard of ethics during the procurement and execution of such contracts, and will avoid to engage in any corrupt and fraudulent practices.

## F. Grievance Redressal & Complaint Review Mechanism

### 40. Constitution of Grievance Redressal

40.1 The Grievance Redressal Committee shall address the grievance, if any submitted by any party, including the bidder, in accordance with Rule 48 of the Public Procurement Rules, 2004 to be read with Redressal of Grievances Regulations, 2021.

40.2 In case if any party or the bidder is not satisfied with the decision of the GRC or if it fails to decide within ten days, the bidder or the party may file an appeal before the Appellate Committee of the Authority in accordance with Rule 48 of the Public Procurement Rules, 2004 to be read with Redressal of Grievances Regulations, 2021.

## G. Mechanism of Blacklisting

### 41. Mechanism of Blacklisting

41.1 The Procuring Agency shall initiate blacklisting proceedings against any bidder, supplier, or contractor in accordance with the Mechanism for Blacklisting Regulations, 2024, read with Rule 19 of the Public Procurement Rules, 2004.

41.2 The blacklisted/debarred bidder may file the review petition before the Authority in accordance with Rule 19 of the Public Procurement Rules, 2004 to be read with Procedure of filing and disposal of Review Petitions Regulations, 2021.





## Bid Data Sheet

## Bids Data Sheet (BDS)


The following specific data for the procurement of Goods to be procured shall complement, supplement, or amend the provisions in the Instructions to Bidders (ITB). Whenever there is a conflict, the provisions herein shall prevail over those in ITB.

BDS Clause Number	ITB Number	Amendments of, and Supplements to, Clauses in the Instruction to Bidders
<b>A. Introduction</b>		
<b>1</b>	<b>1.1</b>	<p>Name of Procuring Agency:<b>PMU HESCO (Hyderabad Electric Supply Company)</b></p> <p>The subject of procurement is:<b>Tender No. PMU 204/25-26 , Procurement of T&amp;P and Testing Equipment</b></p> <p>Expected commencement date: <b>Monday, June 15, 2026</b></p>
<b>2.</b>	<b>2.1</b>	<p>Financial year for the operations of the Procuring Agency:<b>2025-26</b></p> <p>Name and identification number of the Contract: <b>P10577</b></p>
<b>3.</b>	<b>3.1</b>	<p>JV/Consortium or Association Allowed: <b>Yes</b></p> <p>Number of JV/Consortium Members: <b>3</b></p> <p><i>see section of eligibility criteria.</i></p>
<b>B. Bidding Documents</b>		

4.	8.1	The Bidders may seek clarifications through <b>EPADS v2.0</b> : Clarification Date: Tuesday, April 28, 2026
<b>C. Preparation of Bids</b>		
5.	10.1	<p>The Language of all correspondences and documents related to the Bids shall be in: <b>English</b></p> <p>List of documents required along with the bid:</p> <ol style="list-style-type: none"> <li>1. Previous Supply Record (along with GRN/end user certificates etc)</li> <li>2. Technical Data, Drawing Brochures, and deviations if any</li> </ol>
6.	11.1	<p><b>Items/Lots and therrre related documents:</b> <i>See section items and Lots</i></p>
7.	12.1	<p><b>Items / Lots Specifications:</b> <i>see section of items specifications.</i></p>
8.	15.6	The price shall be <b>Fixed</b> .
9.	16.1	Currency of the Bids shall be : <b>PKR</b>
10.	17.1	The Bids/Bid Validity period shall be: <b>120 Days</b>

<p><b>11.</b></p>	<p><b>18.1</b></p>	<p>The amount of Bid Security shall be as defined in Bid Security Section for items and lots given in <b>BDS 6</b></p> <p>The Bid Security shall be in the form of: <b>Pay Order, Banker's Cheque, Call at Deposit, Demand Draft</b></p>
<p><b>D. Submission of Bids</b></p>		
<p><b>12.</b></p>	<p><b>20.1</b></p>	<p>Bid shall be submitted online on EPADS v2.0 whereas hard copy of the bid security should be submitted to the following;</p> <p><b>Project Management Unit Bungalow # A-1 HESCO Colony Hussainabad, Hyderabad.</b> before bid submission deadline.</p> <p>Bids that are not submitted on EPADS v2.0 shall be disqualified.</p> <p>The deadline for Bids submission is: <b>Monday, May 4, 2026 11:00 AM</b></p>
<p><b>E. Opening and Evaluation of Bids</b></p>		
<p><b>13.</b></p>	<p><b>23.1</b></p>	<p>The Bids opening shall take place on <b>EPADS v2.0.</b></p> <p>Day : <b>Monday</b></p> <p>Date: <b>Monday, May 4, 2026</b></p> <p>Time : <b>11:30 AM</b></p>

14.	31.1	Selection technique adopted will be: <b>Least Cost Based Selection (LCBS)</b> <i>see Evaluation Criteria</i>
F. Review of Procurement Decisions		
15.	41.1	Grievance against this procurement shall be submitted online on EPADS v2.0.  Arbitrator shall be appointed by mutual consent of the both parties.

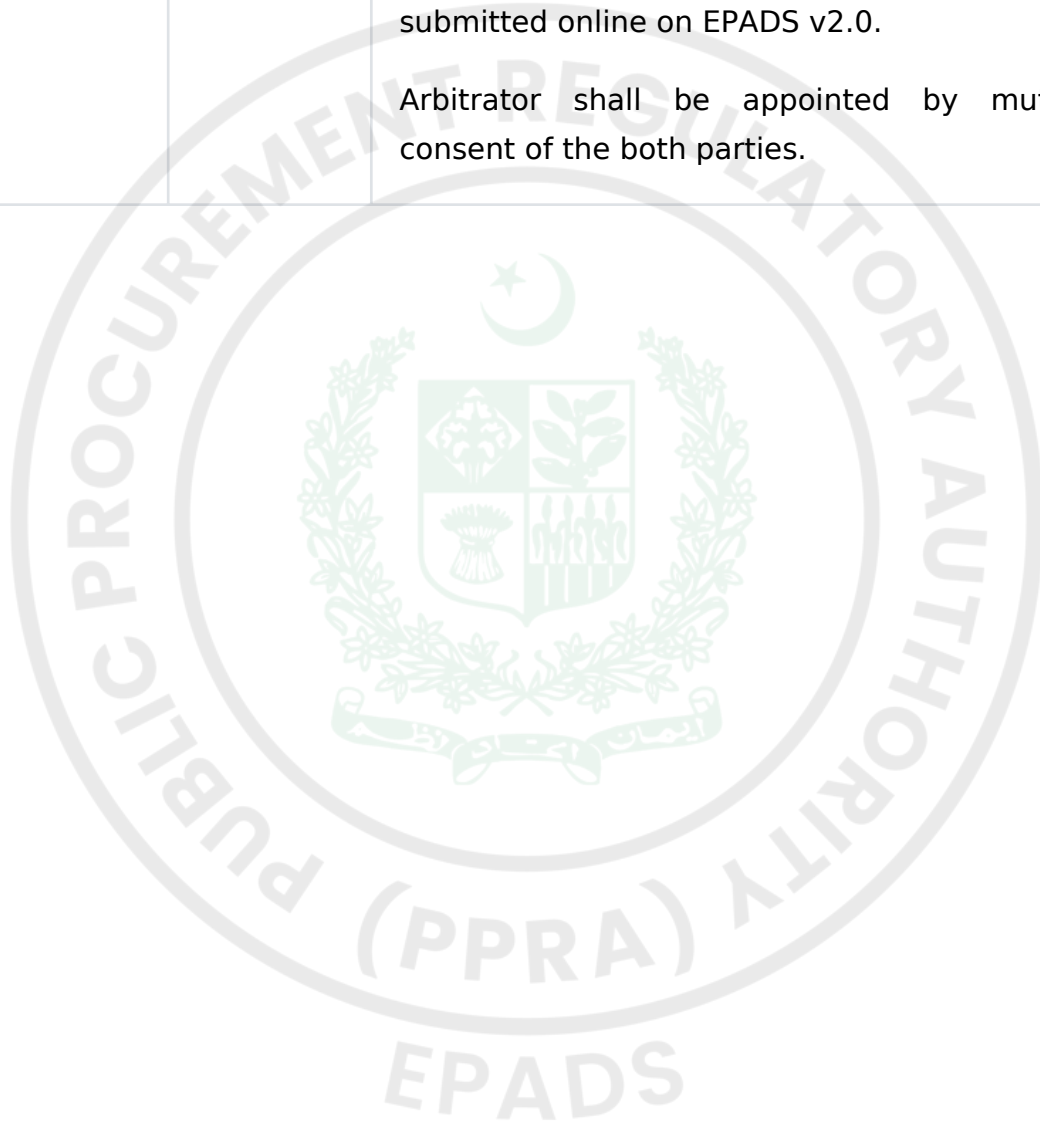

## Eligibility Criteria

Bidder's Type	Required Registration
Sole Proprietorship	NADRA CITIZENSHIP (CNIC/NICOP)
Partnership Firm	FBR (NTN)
Company (Private Limited)	FBR (GSTN)
Company (Public Limited)	SECP Registrar of Firms

Eligibility Criteria	Document
The supplier will be registered with any DISCOs with as Supplier /Manufacturer	Yes

## Evaluation Criteria

Eligible bidder(s) with substantially responsive bid(s) offering **Least Cost Based Selection (LCBS)** shall be consider for the award of contract(s).

### Least Cost Based Selection (LCBS)

### Items/Lots

**Lot Title :** Lot-I

**Bid Security :** 170000

Item	UNSPSC	Delivery Schedule	Quantity	Warranty
Total Station	Total station	<b>Address:</b> Deputy Manager Regional Store, TM Khan Road HESCO Hyderabad. <b>Schedule:</b> 120 Days <b>Quantity:</b> 3	3	2 Years
RTK (Real Time Kinematic) GPS System	Coordinate comparator	<b>Address:</b> Deputy Manager Regional Store, TM Khan Road HESCO Hyderabad. <b>Schedule:</b> 120 Days <b>Quantity:</b> 3	3	2 Years

**Lot Title :** Lot-II

**Bid Security :** 750000

Item	UNSPSC	Delivery Schedule	Quantity	Warranty
CT/PT Analyzer (FREEJA/OMICRON or Equivalent)	Voltage or current meters	<b>Address:</b> Deputy Manager Regional Store, TM Khan Road HESCO Hyderabad. <b>Schedule:</b> 120 Days <b>Quantity:</b> 1	1	2 Years
3-Phase TTR Test Set	Voltage or current meters	<b>Address:</b> Deputy Manager Regional Store, TM Khan Road HESCO Hyderabad. <b>Schedule:</b> 120 Days <b>Quantity:</b> 1	1	2 Years

Item	UNSPSC	Delivery Schedule	Quantity	Warranty
DC Hi-Pot Test Set (120KV)	Circuit tester	<b>Address:</b> Deputy Manager Regional Store, TM Khan Road HESCO Hyderabad. <b>Schedule:</b> 120 Days <b>Quantity:</b> 1	1	2 Years
AC Hi-Pot Test Set (80KV)	Circuit tester	<b>Address:</b> Deputy Manager Regional Store, TM Khan Road HESCO Hyderabad. <b>Schedule:</b> 120 Days <b>Quantity:</b> 1	1	2 Years
Battery Capacity(Grounding) Tester	Impedance meters	<b>Address:</b> Deputy Manager Regional Store, TM Khan Road HESCO Hyderabad. <b>Schedule:</b> 120 Days <b>Quantity:</b> 1	1	2 Years

**Lot Title :** Lot-III

**Bid Security :** 215000

Item	UNSPSC	Delivery Schedule	Quantity	Warranty
132KV HT Grounding Set	Grounding devices or assemblies	<b>Address:</b> Deputy Manager Regional Store, TM Khan Road HESCO Hyderabad. <b>Schedule:</b> 120 Days <b>Quantity:</b> 1	1	2 Years
Hydraulic Conductor Cutter	Wire or cable cutter	<b>Address:</b> Deputy Manager Regional Store, TM Khan Road HESCO Hyderabad. <b>Schedule:</b> 120 Days <b>Quantity:</b> 2	2	2 Years
5 KVA Portable Generator	Diesel generators	<b>Address:</b> Deputy Manager Regional Store, TM Khan Road HESCO Hyderabad. <b>Schedule:</b> 120 Days <b>Quantity:</b> 1	1	2 Years

Item	UNSPSC	Delivery Schedule	Quantity	Warranty
Hydraulic Press Machine	Industrial hydraulic press	<b>Address:</b> Deputy Manager Regional Store, TM Khan Road HESCO Hyderabad. <b>Schedule:</b> 120 Days <b>Quantity:</b> 2	2	2 Years
Hydraulic Jack (100 Ton)	Hydraulic cylinders	<b>Address:</b> Deputy Manager Regional Store, TM Khan Road HESCO Hyderabad. <b>Schedule:</b> 120 Days <b>Quantity:</b> 8	8	2 Years

**Lot Title :** Lot-IV

**Bid Security :** 30000

Item	UNSPSC	Delivery Schedule	Quantity	Warranty
Wooden Sleepers	Railway sleepers	<b>Address:</b> Deputy Manager Regional Store, TM Khan Road HESCO Hyderabad. <b>Schedule:</b> 120 Days <b>Quantity:</b> 25	25	2 Years
Wooden Sleeper	Railway sleepers	<b>Address:</b> Deputy Manager Regional Store, TM Khan Road HESCO Hyderabad. <b>Schedule:</b> 120 Days <b>Quantity:</b> 25	25	2 Years

**Related Services of Goods:**

No

**Items/Lot Specification**

**Lot Title :** Lot-I

**Item:** Total Station

**UNSPSC:** Total station

**Specifications / Requirements:**

KEY SPECIFICATIONS TOTAL STATION Accuracy: 2" (iM-52), 3" (iM-55). Telescope: 30x Magnification, 2.5" Resolving Power, Erect Image, 45mm Aperture. Measurement: Reflectorless (Class 3R), Prism (Class 1), Fine/Rapid/Tracking modes. Range: Up to 4,000m with prism, ~500m reflectorless. Display/Keyboard: Dual Graphic LCD, Alphanumeric Keyboard, Backlit. Data Storage: 50,000 points internal, USB flash drive support (up to 32GB). Durability: IP66, -20°C to +60°C. Battery: Li-ion, long life.

**Item:** RTK (Real Time Kinematic) GPS System

**UNSPSC:** Coordinate comparator

**Specifications / Requirements:**

Attached at end

**Lot Title :** Lot-II

**Item:** CT/PT Analyzer (FREEJA/OMICRON or Equivalent)

**UNSPSC:** Voltage or current meters

**Specifications / Requirements:**

CT/PT Analyzer Test Set 1. General Description The CT/PT Analyzer Test Set is a microprocessor-based multifunction testing instrument designed for automatic testing and evaluation of current transformers (CTs) and potential transformers (PTs) used in substations and protection systems. It performs excitation, ratio, polarity, burden, phase angle, and error tests in accordance with international standards such as IEC 60044, IEC 61869, and IEEE C57.13. 2. Technical Specifications Parameter Specification Power Supply AC 100–240 V, 50/60 Hz Applicable Standards IEC 60044, IEC 61869, IEEE C57.13 Test Methods Excitation, Ratio, Polarity,

Phase Angle, Burden, Knee Point CT Excitation Voltage Output 0 – 2000 V AC or 0 – 1200 V RMS (auto adjustable) CT Excitation Current Output Up to 20 A (auto range) PT Test Voltage Output Up to 120 V AC Measurement Accuracy (Ratio)  $\pm 0.1\%$  Phase Angle Accuracy  $\pm 1$  min or better Knee Point Determination Automatic (IEC 60044-1 compliance) Burden Measurement Range 0 – 300 VA Excitation Curve Plotting Automatic with data storage Polarity Check Automatic detection Data Storage  $\geq 500$  test results internal memory Interface USB / RS232 / LAN for PC data transfer Software PC analysis software for report generation Enclosure Protection IP 54 or better Weight  $\leq 15$  kg

3. Functional Features

- Fully automatic testing of CT and PT parameters with minimal manual connection.
- Performs CT excitation curve plotting and determines knee point voltage & current.
- Measures ratio, phase angle error, polarity, burden, and magnetization characteristics.
- Tests both protection and metering class CTs (5P, 10P, PX, PS, etc.).
- Capable of PT voltage ratio and polarity measurement with accuracy.
- Real-time graphical display of excitation and phase curves.
- Internal database for result storage and automatic report generation.
- Battery or mains powered for field portability.
- USB or LAN connectivity for test result downloads to PC.
- Compatible with external printer for direct report printing.

4. Accessories

- High-voltage and low-voltage test leads with safety connectors
- Current and voltage measurement cables
- Power cable (AC 100–240 V)
- USB data cable
- Calibration certificate
- PC software and user manual
- Carrying case with foam padding
- Optional: external printer and clamp CT adapter

5. Safety & Protection

- Overvoltage and overcurrent protection on all outputs
- Automatic discharge of CT secondary after excitation test
- Interlock protection to prevent incorrect connections
- Over-temperature and short-circuit protection
- Complies with IEC 61010-1 safety requirements
- Emergency stop and grounding terminal provided

6. Applications

- Type testing and routine testing of CTs and PTs in substations
- Testing during commissioning, maintenance, or fault analysis
- Verification of CT/PT ratio, polarity, and burden in protection panels
- Field testing of instrument transformers in 132 kV Grid station
- Calibration and performance verification for protection relays and metering systems

**Item:** 3-Phase TTR Test Set

**UNSPSC:** Voltage or current meters

### **Specifications / Requirements:**

Three-Phase TTR (Transformer Turns Ratio) Test Set

1. General Description The Three-Phase Transformer Turns Ratio (TTR) Test Set is a digital microprocessor-controlled instrument designed to measure the turns ratio, phase angle deviation, and polarity of power, distribution, and instrument transformers. It performs automatic ratio and phase measurement across all three phases

simultaneously, significantly reducing testing time compared to single-phase testers. 2. Technical Specifications Parameter: Specification Test Object: Three-Phase Power, Distribution, and Instrument Transformers Standards Compliance: IEC 60076, IEEE C57.12.90, IEC 61010-1 Measurement Range (Turns Ratio): 1:100,000 or better Measurement Accuracy:  $\pm 0.1\%$  of reading Phase Angle Measurement Range:  $0^\circ - 360^\circ$  Phase Angle Accuracy:  $\pm 0.1^\circ$  Excitation Voltage Output: 0 - 250 V AC (phase selectable, auto adjustable) Excitation Frequency: 50/60 Hz Measurement Time: 10 seconds (for all three phases) Polarity Indication Automatic (additive/subtractive) Vector Group Detection Automatic: (supports all IEC/ANSI vector groups) Magnetizing Current Measurement: 0 - 2 A Voltage Ratio Display: Primary / Secondary (phase-wise) Display: 7" or larger color LCD / touchscreen Data Storage:  $\geq 1000$  test results internal memory Communication Interface: USB / RS232 / LAN for data transfer Software: PC software for report generation and vector diagram display Power Supply: AC 100-240 V, 50/60 Hz Operating Temperature:  $-10^\circ\text{C}$  to  $+60^\circ\text{C}$  Storage Temperature:  $-20^\circ\text{C}$  to  $+60^\circ\text{C}$  Enclosure Protection: IP54 (dust and splash resistant) Dimensions (Approx.): 400 x 300 x 180 mm Weight  $\leq 15$  kg Safety Compliance: IEC 61010-1 (Measurement and Laboratory Equipment Safety) 3. Functional Features • Simultaneous testing of all three phases (ABC) with automatic vector group detection. • Measures turns ratio, phase deviation, polarity, magnetizing current, and excitation voltage. • Compatible with star, delta, zigzag, and other winding connections. • Automatic calculation of deviation from nominal ratio for each phase. • Built-in database and report generator for quick result printing. • On-screen vector diagram display showing actual phase relationships. • Supports manual or automatic test modes. • Quick connection via color-coded test leads for high accuracy and safety. • Rugged design for field use at substations and manufacturing sites. 4. Accessories • Three-phase test lead set with quick-connect clips • Grounding cable and power cord • USB cable for PC data transfer • Software and driver CD • Calibration certificate traceable to international standards • Printed operation and safety manual • Carrying and transport case (shockproof, waterproof) • Optional: external printer and 15 m extended cable set 5. Safety & Protection • Overvoltage and overcurrent protection on all test channels • Automatic discharge of transformer windings after test • Interlock safety feature for incorrect connections • Short-circuit protection and emergency shutdown • Conforms to IEC 61010-1 electrical safety standards • Over-temperature protection and grounding interlock provided 6. Applications • Routine and type testing of power and distribution transformers • Commissioning and maintenance testing in 132 kV grid stations • Verification of vector group, ratio, and polarity before energization • Quality control during transformer manufacturing or repair • Detection of winding connection errors, shorted turns, or phase faults • Testing instrument transformers (CT/PT) for correct ratio and phase angle

**Item:** DC Hi-Pot Test Set (120KV)

**UNSPSC:** Circuit tester

**Specifications / Requirements:**

Parameter	Specification
Model class	Portable / field or two-box design delivering DC 0-120 kV
Maximum output voltage	0 - 120 kV DC, continuously variable
Maximum output current / ranges	Selectable ranges: 2 mA, 3 mA, 5 mA, 10 mA (typical options); continuous and short-duration ratings must be stated.
Voltage accuracy / resolution	Voltage accuracy $\pm(1\%$ of reading $\pm 1$ digit) typical; resolution $\leq 0.1$ kV (or 1 V in lower ranges)
Current accuracy / resolution	Current accuracy $\pm(1\%$ reading $\pm 1$ digit); leakage measurement down to $0.1 \mu\text{A}$ — $1 \mu\text{A}$ resolution depending on model
Voltage stability / regulation	$\leq 1\%$ change for mains $\pm 10\%$
Ripple / DC quality	Ripple factor 0.5% (where specified)
Polarity	Selectable polarity (positive/negative) and no-voltage / zero-start safety interlock
Ramp & timing	Programmable ramp up/down, dwell time and test duration (e.g., 1 s - 99 h) with segmented timing
Protection / trip functions	Overcurrent trip, overvoltage trip, earth/ground detection, arcing/breakdown detection, automatic shut-down on fault

Parameter	Specification
Discharge	Built-in resistive discharge network and automatic discharge relay; discharge time 5 s
Metering & display	Digital display (voltage, current, time); some analog/dedicated metering on legacy models; optional graphic touchscreen on advanced models
Data & communications	USB & RS-232 / optional Ethernet or Bluetooth; internal logging (N records) and PC software for reports
Power supply	AC mains: 230 V $\pm$ 10% 50/60 Hz (115 V option on some units)
Cooling	Natural convection for small units; forced-air cooling for higher power continuous duty units
Mechanical / portability	Single-box or two-box design; control console + HV tank/transformer in separate oil-filled tank for 120 kV designs; transport case / wheels optional
HV output & accessories	Shielded HV cable(s), insulated output clamp, earth lead ( $\geq$ 3 m typical), pressure-doubling cylinder (if used for compact sets)
Safety features	Zero-start interlock, safety earth check, E-STOP, HV ON indicators, audible alarm, case interlock
Environmental / operating	Operating: $-10$ °C to $+50$ °C (vendor to confirm); Relative humidity up to 95% non-condensing typical
Standards / compliance	IEC 60060-1 (high voltage test methods), IEC 61010-1 (safety), CE / EMC where applicable; calibration traceable to national standards
Typical weight / dimensions	Varies widely: lightweight modules (control box $\sim$ 10–20 kg + HV tank, typically 40cm x 30cm x 30cm)
Optional features	PD detection interfaces, combo AC/DC sets, larger current modules (up to 10 mA), touchscreens, printer, extended HV cable lengths, calibration certificate

**Item:** AC Hi-Pot Test Set (80KV)

**UNSPSC:** Circuit tester

**Specifications / Requirements:**

Parameter	Specification
General	Portable AC high-potential (Hi-Pot) test set for dielectric/insulation testing of equipment rated up to 132 kV, providing reliable AC test voltages up to 80 kV for both field and laboratory applications.
Output Voltage Range	1 kV - 80 kV AC (continuously variable)
Maximum Output Current	50-100 mA (selectable / limited)
Voltage Resolution	0.1 kV (or better)
Current Measurement Resolution	0.1 $\mu$ A
Output Type	AC sinusoidal, 50 / 60 Hz selectable
Frequency	50 / 60 Hz
Metering / Display	Digital display (Voltage, Current $\mu$ A, Test time, Pass/Fail)
Data Interface	USB standard + optional Ethernet/Bluetooth
Power Supply	230 V AC $\pm$ 10%, 50 Hz (115 V optional)
Cooling	Forced-air cooling with thermal control

Parameter	Specification
Operating Temperature	-10 °C to +60 °C
Protection / Safety	Emergency stop, interlocks, overcurrent, overvoltage, overtemperature, earth-fault
Alarms	Audible and visual alarms (HV ON, Fault)
Enclosure	Rugged portable case with wheels & handles
Standards	IEC 60060-1 / IEC 61010-1 / IEEE 510
Accessories (Standard)	HV cable set, grounding cable, interlock lead, power cable, USB cable, manual, carrying case
Optional Accessories	PC software, remote control pendant, long HV leads, calibration certificate
Weight & Dimensions	≤ 60 kg; compact portable chassis
Functional Features	Continuous and stable AC output up to 80 kV with programmable ramp profiles. Real-time leakage current and voltage monitoring with data logging. Enhanced operator safety via interlocks and emergency trip systems. USB data export and optional PC software for reporting.

**Item:** Battery Capacity(Grounding) Tester

**UNSPSC:** Impedance meters

**Specifications / Requirements:**

1. General Features Portable automatic battery discharge test set for testing and analyzing 110V DC battery banks (130-150 Ah). Suitable for substation, power plant, and industrial battery systems. Provides real-time monitoring and recording of discharge

parameters. Compact and rugged design with cooling and protection systems. Operates on 220V AC, 50 Hz power supply. Built-in charger Model: DR150V, Make: BATTERY. Complies with relevant IEC and international testing standards. 2. Electrical Specifications. Feature: Specification Discharge Current Range: 0-130 A Current Accuracy:  $\pm 1\%$  Battery Voltage Range: 0-300 V DC Voltage Accuracy:  $\pm 1\%$  Supported Battery Type: 110 V DC, 130-150 Ah (Lead-acid / Ni-Cd) Input Power: 220 V AC, 50 Hz Discharge Mode: Constant Current / Constant Power Protection: Thermal protection and polarity reversal Internal Memory: Built-in for test data storage. 3. Measurement & Display Parameters Displayed data shall include discharge current, Ah discharged, test duration, battery voltage and time. Graphical display must show real-time discharge curve and selectable load patterns. Measurement recording shall be automatic with timestamps and reviewable on-screen or via PC software; data export in PDF, Excel or CSV formats. 4. Testing Capabilities Performs both constant current and constant power discharge tests. Measures and records battery voltage drop, discharge current, ampere-hour capacity, discharge time and load profile. Automatic stop at preset voltage or time limits. Provides comprehensive performance analysis and report generation. 5. Safety and Protection Thermal overload protection and reverse polarity protection with automatic cutoff on abnormal conditions. Built-in cooling system for extended duration testing. 6. Standards Compliance IEC 61010-1 (Safety Requirements for Electrical Equipment); IEC 61326 (EMC Compliance); ISO 9001 quality management. 7. Accessories Battery discharge cables with appropriate connectors, power cord and grounding cable, PC connection cable and software, heavy-duty carrying case, and instruction/operation manual.

**Lot Title :** Lot-III

**Item:** 132KV HT Grounding Set

**UNSPSC:** Grounding devices or assemblies

**Specifications / Requirements:**

Technical Specification Sheet 132KV Portable Grounding Set A 132kV portable grounding set (or earthing set) is essential safety equipment used to temporarily ground de-energized high-voltage conductors or equipment in substations and on transmission lines. Its primary purpose is to protect personnel by ensuring the line or equipment remains at zero potential, primarily by dissipating stored energy, draining induced voltages, and conducting any accidental or back-fed fault current to the earth. Parameter: Specification / Detail Rated Voltage: 132 kV (for use on systems with a highest voltage of 145 kV) Application: High-voltage

overhead line conductors, busbars, and switchgear terminals. System Earthing: Suitable for Effectively Earthed systems. Safety Purpose: To create an Equipotential Zone (EPZ) around the work area, preventing hazardous differences in electric potential. Operating Standards: Must conform to relevant international safety and equipment standards, such as IEEE 80 (Substation Grounding), ASTM F855, and IEC 60855 / 61230 (Insulating/Grounding equipment). Rated Short-Circuit: Current 31.5 kA to 40 kA (RMS) Short-Circuit Duration: 3 seconds (or as specified) Conductor Ampacity: Grounding leads must have an ampacity capable of conducting the maximum fault current. Common minimum for EHV is often  $\geq 120$  mm<sup>2</sup> stranded copper cable. Impulse Withstand Voltage (Live-End Clamp): Minimum of 650 kV Peak (1.2/50 $\mu$ s) Phase / Live-End Clamps: Designed for round or flat busbars and various conductor diameters (e.g., up to 60 mm). Features robust serrated jaws for secure, low-resistance connection. Ground-End Clamp: Designed for attachment to the substation earth mat, ground rod, or structure. Must ensure a quick, secure, and permanent connection. Grounding Conductors (Leads): Highly flexible, transparent/clear sheathed, extra-flexible copper cable (e.g., 120 mm<sup>2</sup> to 150 mm<sup>2</sup>). Lengths vary (e.g., 5 m to 20 m), rated for the 40 kA fault current. Operating (Hot) Stick: Telescopic or sectional insulating rod. Must be rated for the full system voltage (145 kV). Junction Terminal (Optional): A common terminal, usually a triangular plate, where multiple phase leads converge before connecting to a single earth lead. Connectors/Ferrules: Leads must be compression-cripped to clamps using high-quality terminals or ferrules, often exothermic welded to eliminate weak points.

**Item:** Hydraulic Conductor Cutter

**UNSPSC:** Wire or cable cutter

**Specifications / Requirements:**

Technical Specifications Manual Hydraulic Conductor Cutter Parameter: Specification / Typical Range Max Cutting Capacity (Conductor): 600 mm<sup>2</sup> to 800 mm<sup>2</sup> (Copper/Aluminium) Max Cutting Diameter:  $\approx 40$  mm to 55 mm (Overall Cable) Maximum Cutting Force: 45 kN to 88 kN (4.5 Tonnes to 9 Tonnes) Operating Pressure: 700 bar (10,000 PSI) Pump Action: Double Speed Action (or Two-Stage Pump) Blade Material: High-strength forged or chrome-vanadium tool steel Cut Quality: Clean, crush-free cut Tool Type: Hand Hydraulic Cutter (Integral Pump) Head Design: Flip-Top / Open Head Head Rotation: 180° to 360° Swivel Hydraulic Fluid: Mineral Oil or equivalent Safety Features: Automatic Safety Valve Weight:  $\approx 4$  kg to 7 kg Dimensions (Length):  $\approx 500$  mm to 650 mm Handle/Grip: Ergonomic, non-slip handles (e.g., rubberized or PVC). Operational and Ergonomic Features • Head Design: Features a Flip-Top or Open Head (often pivots 90 degree or more) that allows the operator to easily insert running cables (cables already laid

in a trench or on a tray) without needing to thread the cable through. •Head Rotation: The head can typically rotate 180° to 360° relative to the handles, allowing the operator to position the tool optimally for comfort and leverage in confined spaces. •Portability: Designed to be lightweight for a high-capacity tool (typically 4 kg to 7kg), allowing for comfortable two-handed operation and easy transport in a carrying case. •Operation: Cutting is achieved by repeatedly pumping the operating handle. The cut is released by operating a pressure release device or release lever on the handle, which retracts the blade. Safety and Limitations • Safety Valve: Includes an Automatic Safety Valve that protects the tool by bypassing the hydraulic fluid once the maximum safe working pressure (Approx. 700 bar) or maximum force is reached. • Blade Stop: The cut can generally be interrupted and the blade retracted at any point during the cutting cycle by engaging the release mechanism. • Non-Insulated: Crucially, this tool is typically NOT insulated. The operator must never use the cutter on or near energized electrical lines. Proper personal protective equipment (PPE) and confirmation that the cable is de-energized are mandatory.

**Item:** 5 KVA Portable Generator

**UNSPSC:** Diesel generators

**Specifications / Requirements:**

Feature	Specification
Output	5 kVA (Apparent Power) / 4 kW (Rated Power Factor of 0.8)
Engine Type	Single cylinder, 4-stroke, air-cooled diesel or petrol engine
Engine Speed	Typically 3000 RPM (for 50 Hz frequency)
Fuel Type	Diesel (e.g., HSD-ASTM D2) or Petrol/Gasoline
Fuel Tank Capacity	15-16 Liters (approx. 7-8 hours continuous running at 75% load)
Fuel Consumption	Approx. 1.5-2.0 LPH (Liters Per Hour) at 75-100% load
Alternator	Brushless, self-excited, Class H insulation

Feature	Specification
Rated Current (Amps)	approx 17.4 (at 230 V, 0.8 PF)
Voltage Regulation	Automatic Voltage Regulator (AVR) or Capacitor regulated (+/- 5% to +/- 10% regulation)
Control Panel	Features voltmeter, ammeter, frequency meter, hour meter, and AC output sockets
Dimensions (L x W x H)	Approx. 900 x 550 x 750 mm (varies by model)
Weight (Dry)	Approx. 150–200 kg (varies, especially for silent/enclosed units)
Starting System	Electric Start (12V DC) and/or Recoil (Pull Cord)
Noise Level	68 dBA to 75 dBA at 7 meters
Insulation Class	Class F or Class H
Control Panel	Includes MCB/Circuit Breaker (for overload protection), output sockets (e.g. 16 A or 32A), and instrumentation (Voltmeter, Hour Meter).

**Item:** Hydraulic Press Machine

**UNSPSC:** Industrial hydraulic press

**Specifications / Requirements:**

Parameter	Specification / Detail
Rated Pressing Force / Capacity	100 tons (100 t)

Parameter	Specification / Detail
Maximum Working Pressure	700 bar
Max Stroke	26 mm
Maximum Hexagonal Key Size	57 mm
Weight-to-Power Ratio	3.1 ton per kg
Press Weight	32 kg
Die / Tool Weight (Typical)	~1.5kg
Operation / Drive Mechanism	Hydraulic
Application / Use Case	Compression of joints on conductors and steel ropes (e.g., medium/high-voltage electrical line work).
Portability / Handling	Ultra-light press design (32kg) — suitable for working on suspension platforms, towers, and field deployment.
Case / Packing Dimensions	50×70×62cm

**Item:** Hydraulic Jack (100 Ton)

**UNSPSC:** Hydraulic cylinders

**Specifications / Requirements:**

100 Ton is the minimum requirement all other parameters are in accordance

**Lot Title :** Lot-IV

**Item:** Wooden Sleepers

**UNSPSC:** Railway sleepers

**Specifications / Requirements:**

Wooden Slippers 1. Slippers should be Pine wood 2. Slippers should be dried to prevent bending of wood 3. Dimensions of wooden slippers be within range of I. Length: 13 Foot 6 Inch II. Width: 08 Inch III. Height: 5.5 Inch

**Item:** Wooden Sleeper

**UNSPSC:** Railway sleepers

**Specifications / Requirements:**

Wooden Slippers 1. Slippers should be Pine wood 2. Slippers should be dried to prevent bending of wood 3. Dimensions of wooden slippers be within range of I. Length: 13 Foot 6 Inch II. Width: 08 Inch III. Height: 5.5 Inch

## Price Schedule

### For Individual Items

#	Item Title	Quantity	Unit Price (PKR)	Total Price (PKR)	Delivery Location	Delivery Period / Year	Country of Origin
1							
2							

### For Lots

#	Lot Title	Total Lot Price (PKR)	Country of Origin
---	-----------	-----------------------	-------------------

1	[Lot 1 Title]		
---	---------------	--	--







## General Conditions of Contract

## A. General

### 1. Definitions

1.1 Unless the context otherwise requires, the following terms whenever used in this Contract shall have the same meaning and shall be interpreted as indicated

1. "Applicable Law" means the laws and any other instruments having the force of law in the Government's Country, or in such other country as may be specified in the Special Conditions of the Contract (SC), as they may be issued and in force from time to time;
2. "Procuring Agency" means:-
  - 2.1. any Ministry, Division, Department or any Office of the Government;
  - 2.2. any authority, corporation, body or organization established by or under a Law or which is owned or controlled by the Government;
3. "The Contract" means an agreement enforceable by law;
4. "The Contract Price" means the price payable to the Bidder under the Contract for the full and proper performance of its contractual obligations;
5. "Ancillary Services" means those services ancillary to the provision of Goods, such as transportation and insurance, and any other incidental services, such as installation, commissioning, provision of technical assistance, training, and other such obligations of the Bidder covered under the Contract;
6. "GCC" means the General Conditions of Contract contained in this section;
7. "SCC" means the Special Conditions of Contract by which the GCC may be amended or supplemented;
8. "Day" means calendar day unless indicated otherwise.
9. "Effective Date" means the date on which this Contract comes into force and effect.
10. "The Bidder" means the individual or corporate body whose Bids to provide the Goods has been accepted by the Procuring Agency;
11. "The Project Site," where applicable, means the place or places named in Bids Data Sheet and technical Specifications;
12. "Government" means the Government of Pakistan;
13. "Subcontractor" means any entity to which the Bidder subcontracts any part of the Goods.
14. "Service" means any object of procurement other than goods or works;
15. "Party" means the Procuring Agency or the Bidder, as the case may be, and "Parties" means both of them;
16. "Foreign Currency" means any currency other than the currency of the country of the Procuring Agency;

17. "Completion Date" means the date of completion of the contract by the Bidder as certified by the Procuring Agency;

18. "In Writing" means communicated in written form with proof of receipt;

19. "Local Currency" means the currency of Pakistan;

## 2. Application and Interpretation

2.1 These General Conditions shall apply to the extent that they are not superseded by provisions of other parts of the Contract.

2.2 In interpreting these Conditions of Contract headings and marginal notes are used for convenience only and shall not affect their interpretations unless specifically stated; references to singular include the plural and vice versa; and masculine include the feminine. Words have their ordinary meaning under the language of the Contract unless specifically defined.

## 3. Applicable Law

3.1 The contract shall be governed and interpreted in accordance with the laws of Pakistan, unless otherwise specified in SCC.

## 4. Governing Language

4.1 The Contract as well as all correspondence and documents relating to the Contract exchanged between the Bidder and the Procuring Agency, shall be written in the **English language** unless otherwise stated in the **SCC**. Supporting documents and printed literature that are part of the Contract may be in another language provided these are accompanied by an accurate translation of the relevant passages in English, in which case, for purposes of interpretation of the Contract, this translation shall govern.

## 5. Notices

5.1 Any notice, request, or consent made pursuant to this Contract shall be in writing and shall be deemed to have been made when delivered in person to an authorized representative of the Party to whom the communication is addressed, or when sent by registered mail, telex, telegram, or facsimile to such Party at the address specified in the **SCC**.

## 6. Delivery/Location

6.1 The Goods shall be delivered to such locations as the Procuring Agency may approve and as specified in **SCC**.

## 7. Authorized Representatives / Authority of Member in charge

7.1 Any action required or permitted to be taken, and any document required or permitted to be executed, under this Contract by the Procuring Agency or the Bidder may be taken or executed by the officials specified in the **SCC**.

## B. Commencement, Completion, Modification, and Termination of Contract

## 8. Effectiveness of Contract

8.1 This Contract shall come into effect on the date the Contract is signed by both parties and such other later date as may be stated in the SCC.

## 9. Commencement of Services

9.1 The Bidder shall confirm availability of Key Experts and begin carrying out the Services not later than the number of days after the Effective Date specified in the SCC.

## 10. Program

10.1 Before commencement of the Services, the Bidder shall submit to the Procuring Agency for approval a Program showing the general methods, arrangements, order and timing for all activities. The Services shall be carried out in accordance with the approved Program as updated.

## 11. Starting Date/Expiration Date

11.1 The Bidder shall start carrying out the Services Five (05) days after the date the Contract becomes effective, or at such other date as may be specified in the SCC.

11.2 Unless terminated earlier pursuant to Clause **GCC 15** hereof, this Contract shall expire at the end of such time period after the Effective Date as specified in the SCC.

## 12. Entire Agreement

12.1 This Contract contains all covenants, stipulations and provisions agreed by the Parties. No agent or representative of either Party has authority to make, and the Parties shall not be bound by or be liable for, any statement, representation, promise or agreement not set forth herein.

## 13. Modification

13.1 Any modification or variation of the terms and conditions of this Contract, including any modification or variation of the scope of the Services, may only be made by written agreement between the Parties. However, each Party shall give due consideration to any Bids for modification or variation made by the other Party.

13.2 In cases of any modifications or variations, the prior written consent of the Procuring Agency is required.

## 14. Force Majeure

### 14.1 Definition

For the purposes of this Contract, "Force Majeure" means an event which is beyond the reasonable control of a Party and which makes a Party's performance of its obligations under the Contract impossible or so impractical as to be considered impossible under the circumstances.

## **14.2 No Breach of Contract**

The failure of a Party to fulfill any of its obligations under the contract shall not be considered to be a breach of, or default under, this Contract in so far as such inability arises from an event of Force Majeure, provided that the Party affected by such an event (a) has taken all reasonable precautions, due care and reasonable alternative measures in order to carry out the terms and conditions of this Contract, and (b) has informed the other Party as soon as possible about the occurrence of such an event.

## **14.3 Extension of Time**

Any period within which a Party shall, pursuant to this Contract, complete any action or task, shall be extended for a period equal to the time during which such Party was unable to perform such action as a result of Force Majeure.

## **14.4 Payments**

During the period of their inability to perform the Services as a result of an event of Force Majeure, the Bidder shall be entitled to continue to be paid under the terms of this Contract, as well as to be reimbursed for additional costs reasonably and necessarily incurred by them during such period for the purposes of the Services and in reactivating the Service after the end of such period.

## **15. Termination**

### **15.1 By the Procuring Agency**

The Procuring Agency may terminate this Contract in case of the occurrence of any of the events specified in paragraphs (a) through (e) of this Clause. In such an occurrence the Procuring Agency shall give at least thirty (30) calendar days' written notice of termination to the Bidder in case of the events referred to in (a) through (d); at least sixty (60) calendar days' written notice in case of the event referred to in (e);

1. If the Bidder fails to remedy a failure in the performance of its obligations hereunder, as specified in a notice of suspension;
2. If the Bidder becomes (or, if the Bidder consists of more than one entity, if any of its members becomes) insolvent or bankrupt or enter into any agreements with their creditors for relief of debt or take advantage of any law for the benefit of debtors or go into liquidation or receivership whether compulsory or voluntary;
3. If the Bidder fails to comply with any final decision reached as a result of arbitration proceedings;
4. If, as the result of Force Majeure, the Bidder is unable to perform a material portion of the Services for a period of not less than sixty (60) calendar days;
5. If the Procuring Agency, in its sole discretion and for any reason whatsoever, decides to terminate this Contract;

### **15.2 By the Bidder**

The Bidder may terminate this Contract, by not less than thirty (30) calendar days' written notice to the Procuring Agency, in case of the occurrence of any of the events specified in paragraphs (a) through (d) of this Clause.

1. If the Procuring Agency fails to pay any money due to the Bidder pursuant to this Contract and not subject to dispute within forty-five (45) calendar days after receiving written notice from the Bidder that such payment is overdue.
2. If, as the result of Force Majeure, the Bidder is unable to perform a material portion of the Services for a period of not less than sixty (60) calendar days.
3. If the Procuring Agency fails to comply with any final decision reached as a result of arbitration.
4. If the Procuring Agency is in material breach of its obligations pursuant to this Contract and has not remedied the same within forty-five (45) days (or such longer period as the Bidder may have subsequently approved in writing) following the receipt by the Procuring Agency of the Bidder's notice specifying such breach.

## C. Obligations of the Bidder

### 16. General

#### 16.1 Standard of Performance

1. The Bidder shall deliver the product and carry out the Services with all due diligence, efficiency and economy, in accordance with generally accepted professional standards and practices, and shall observe sound management practices, and employ appropriate technology and safe and effective equipment, machinery, materials and methods. The Bidder shall always act, in respect of any matter relating to this Contract or to the Services, as a faithful adviser to the Procuring Agency, and shall at all times support and safeguard the Procuring Agency's legitimate interests in any dealings with the third parties.

#### 16.2 Law Applicable to Goods

The Bidder shall deliver the goods in accordance with the Contract and in accordance with the Law of Pakistan and shall take all practicable steps to ensure that any of its Experts and Sub-Bidders, comply with the Applicable Law.

### 17. Conflict of Interests

#### 17.1 Bidder Not to Benefit from Commissions and Discounts.

The remuneration of the Bidder shall constitute the Bidder's sole remuneration in connection with this Contract or the Services, and the Bidder shall not accept for their own benefit any trade commission, discount, or similar payment in connection with activities pursuant to this Contract or to the Services or in the discharge of their obligations under the Contract, and the Bidder shall use their best efforts to ensure that the Personnel, any Subcontractors, and agents of either of them similarly shall not receive any such additional remuneration.

#### 17.2 Bidder and Affiliates Not to be Otherwise Interested in Project

The Bidder agree that, during the term of this Contract and after its termination, the Bidder and its affiliates, as well as any Subcontractor and any of its affiliates, shall be disqualified from providing Goods for any project resulting from or closely related to the Services.

#### 17.3 Prohibition of Conflicting Activities

Neither the Bidder nor its Subcontractors nor the Personnel shall engage, either directly or indirectly, in any of the following activities:

1. during the term of this Contract, any business or professional activities in the Government's country which would conflict with the activities assigned to them under this Contract;
2. during the term of this Contract, neither the Bidder nor their Subcontractors shall hire public employees in active duty or on any type of leave, to perform any activity under this Contract;

## 18. Confidentiality

18.1 Except with the prior written consent of the Procuring Agency, the Bidder and the Experts shall not at any time communicate to any person or entity any confidential information acquired in the course of the contract.

## 19. Insurance to be Taken Out by the Bidder

19.1 The Bidder(a) shall take out and maintain, and shall cause any Subcontractors to take out and maintain, at its (or the Subcontractors', as the case may be) own cost but on terms and conditions approved by the Procuring Agency, insurance against the risks, loss or damage, and for the coverage, as shall be specified in the SCC; and (b) at the Procuring Agency's request, shall provide evidence to the Procuring Agency showing that such insurance has been taken out and maintained and that the current premiums have been paid.

## 20. Bidder's Actions Requiring Procuring Agency's Prior Approval

20.1 The Bidder shall obtain the Procuring Agency's prior approval in writing before taking any of the following actions:

- (a) appointing such members of the Personnel not provided by the Bidder;
- (b) changing the Program of activities; and
- (c) any other action that may be specified in the SCC.

## 21. Reporting Obligations

21.1 The Bidder shall submit to the Procuring Agency the reports and documents in the numbers, and within the periods as prescribed by the Procuring Agency.

## 22. Liquidated Damages

22.1 If the Supplier fails to deliver any or all of the Goods or to perform the Services within the period(s) specified in the Contract, the Procuring Agency shall, without prejudice to its other remedies under the Contract, deduct from the Contract Price, as liquidated damages, a sum equivalent to the percentage specified in SCC of the delivered price of the delayed Goods or unperformed Services for each week or part thereof of delay until actual delivery or performance, up to a maximum deduction of the performance security (or guarantee) specified in SCC. Once the said maximum is reached, the Procuring Agency may consider termination of the Contract pursuant to **GCC Clause 15**.

## 22.2 Correction for Over-payment

If the Intended Completion Date is extended after liquidated damages have been paid, the Procuring Agency shall correct any overpayment of liquidated damages by the Bidder by adjusting the next payment certificate. The Bidder shall be paid interest on the overpayment, calculated from the date of payment to the date of repayment, at the rates specified in SCC.

## 22.3 Lack of performance penalty

If the Bidder has not corrected a Defect within the time specified in the Procuring Agency's notice, a penalty for Lack of performance will be paid by the Bidder. The amount to be paid will be calculated as a percentage of the cost of having the Defect corrected, assessed as specified in the SCC.

## 23. Performance Guarantee

23.1 Within Seven (07) days from the issuance of acceptance letter from the Procuring Agency, the successful Bidder shall furnish the Performance Guarantee in shape of ----- at the discretion of the PA in the amount **specified in SCC**. In case the amount of Bids security is equal or greater than

23.2 The proceeds of the Performance Guarantee shall be payable to the Procuring agency as compensation for any loss resulting from the Supplier's failure to complete its obligations under the Contract.

23.3 The Performance Guarantee shall be denominated in the currency of the Contract, or in a freely convertible currency acceptable to the Procuring agency and shall be in the acceptable form as specified in SCC.

23.4 The Performance Guarantee will be discharged by the Procuring agency and returned to the Supplier not later than thirty (30) days following the date of completion of the Supplier's performance obligations under the Contract, including any warranty obligations, unless otherwise **specified in SCC**.

## 24. Fraud and Corruption

24.1 The Procuring Agency requires the Supplier to disclose any commissions or fees that may have been paid or are to be paid to agents or any other party with respect to the Bidding process or execution of the Contract. The information disclosed must include at least the name and address of the agent or other party, the amount and currency, and the purpose of the commission, gratuity or fee.

## 25. Sustainable Procurement

25.1 The Bidder shall conform to the sustainable procurement contractual provisions, if and as specified in the SCC.

## D. Bidder's Personnel

### 26. Description of Personnel

26.1 The titles, agreed job descriptions, minimum qualifications, and estimated periods of engagement in the carrying out of the Services of the Bidder's Key Personnel. The Key Personnel listed by title as well as by name are hereby approved by the Procuring Agency.

## 27. Removal and/or Replacement of Personnel

27.1 Except as the Procuring Agency may otherwise agree, no changes shall be made in the Key Personnel. If, for any reason beyond the reasonable control of the Bidder, it becomes necessary to replace any of the Key Personnel, the Bidder shall provide as a replacement a person of equivalent or better qualifications.

27.2 If the Procuring Agency finds that any of the Personnel have (i) committed serious misconduct or have been charged with having committed a criminal action, or (ii) have reasonable cause to be dissatisfied with the performance of any of the Personnel, then the Bidder shall, at the Procuring Agency's written request specifying the grounds thereof, provide as a replacement a person with qualifications and experience acceptable to the Procuring Agency.

27.3 The Bidder shall have no claim for additional costs arising out of or incidental to any removal and/or replacement of Personnel.

## E. Obligations of the Procuring Agency

### 28. Assistance and Exemptions

28.1 The Procuring Agency shall use its best efforts to ensure that the Government shall provide the Bidder such assistance and exemptions as specified in the SCC.

### 29. Change in the Applicable Law

29.1 If, after the date of this Contract, there is any change in the Applicable Law with respect to taxes and duties which increases or decreases the cost of the related Services rendered by the Bidder, then the remuneration and reimbursable expenses otherwise payable to the Bidder under this Contract shall be increased or decreased accordingly by agreement between the Parties, and corresponding adjustments shall be made to the amounts referred in the SCC.

### 30. Services and Facilities

30.1 The Procuring Agency shall make available to the Bidder and the Experts, for the purposes of the Services and free of any charge, the services, facilities and property described, at the times and in the manner specified in the SCC or terms of reference.

30.2 In case that such services, facilities and property shall not be made available to the Bidder, the Parties shall agree on (i) any time extension that it may be appropriate to grant to the Bidder for the performance of the Services, (ii) the manner in which the Bidder shall procure any such services, facilities and property from other sources, and (iii) the additional payments, if any, to be made to the Bidder as a result thereof.

## F. Payments to the Bidder

### 31. Contract Price

31.1 The price payable shall be in Pakistani Rupees unless otherwise specified in the SCC. Prices charged by the Supplier for Goods delivered under the Contract shall not vary from the prices quoted by the Supplier in its Bid.

## 32. Terms and Conditions of Payment

32.1 Payments will be made to the Bidder according to the payment schedule stated in the SCC and as per actual invoice submitted by the Bidder.

32.2 Unless otherwise stated in the SCC, the advance payment shall be made against the provision by the Bidder of a bank guarantee for the same amount, and shall be valid for the period stated in the SCC. Any other payment shall be made after the conditions listed in the SCC for such payment have been met, and the Bidder have submitted an invoice to the Procuring Agency specifying the amount due.

## 33. Currency of Payment

33.1 Any payment under this Contract shall be made in the currency(ies) specified in the SCC.

## G. Quality Control

### 34. Identifying Defects

34.1 The principle and modalities of Inspection of the Goods by the Procuring Agency shall be as indicated in the SCC. The Procuring Agency shall check the Bidder's performance and notify him of any Defects that are found. Such checking shall not affect the Bidder's responsibilities. The Procuring Agency may instruct the Bidder to search for a Defect and to uncover and test any service that the Procuring Agency considers may have a Defect. Defect Liability Period is as defined in the SCC.

### 35. Correction of Defects, and

#### **Lack of Performance Penalty**

35.1 The Procuring Agency shall give notice to the Bidder of any Defects before the end of the Contract. The Defects liability period shall be extended for as long as Defects remain to be corrected.

35.2 Every time notice a Defect is given, the Bidder shall correct the notified Defect within the length of time specified by the Procuring Agency's notice.

35.3 If the Bidder has not corrected a Defect within the time specified in the Procuring Agency's notice, the Procuring Agency will assess the cost of having the Defect corrected, the Bidder will pay this amount, and a Penalty for Lack of Performance.

## 36. Taxes and Duties

36.1 A Supplier shall be entirely responsible for all taxes, duties, fees, etc., incurred until delivery of the contracted Goods to the Procuring Agency.

## H. Settlement of Disputes

### 37. Alternate Dispute Resolution

37.1 The disputes between the parties to the contract may be settled in accordance with Public Procurement Rules, 2004.

37.2 The procuring agency shall refer the matter to the Chief Justice Islamabad High Court or Managing Director PPRA or the Secretary Ministry of Law & Justice for appointment of Arbitrator.

37.3 The fee for the Arbitrator shall be specified in Pak Rupees as determined by the appointing authority which shall be borne and shared equally by the contracting parties.





## Special Conditions of Contract

## SECTION VIII. SPECIAL CONDITIONS OF CONTRACT

The following Special Conditions of Contract shall supplement the General Conditions of Contract. Whenever there is a conflict, the provisions herein shall prevail over those in the Conditions of Contract. The corresponding clause number of the GCC is indicated in parentheses.

<b>Number of GC Clause</b>	<b>Amendments of, and Supplements to, Clauses in the General Conditions of Contract</b>
<b>GCC 1</b>	<p><b>Definitions</b></p> <p><b>The Procuring Agency is:</b> PMU HESCO (Hyderabad Electric Supply Company), Director General Procurement Project Management Unit Bungalow # A-1 HESCO Colony Hussainabad, Hyderabad.</p> <p><b>The Supplier is:</b></p> <p><b>The title of the subject procurement is: Tender No. PMU 204/25-26 , Procurement of T&amp;P and Testing Equipment</b></p>
<b>GCC 3</b>	<p><b>Applicable/Governing Law:</b></p> <p>The Contract shall be interpreted in accordance with the laws of Islamic Republic of Pakistan</p>
<b>GCC 4</b>	<p><b>Language:</b></p> <p>The language of the Contract, all correspondence and communications to be given, and all other documentation to be prepared and supplied under the Contract shall be in <b>English</b>.</p>

<p><b>GCC 5</b></p>	<p><b>Notices:</b></p> <p><b>The addresses for the notices are:</b></p> <p>Procuring Agency:</p> <p>PMU HESCO (Hyderabad Electric Supply Company), Director General Procurement Project Management Unit Bungalow # A-1 HESCO Colony Hussainabad, Hyderabad. +92-337-219-2716 dgprocurement@hesco.gov.pk</p> <p>Contractor/ Bidder:</p> <p>[Name, address and telephone number].</p> <p>The Contractor/ Bidder’s Representative(s)</p> <p>[Name, address, telephone number and e-mail address]</p>
<p><b>GCC 7.1</b></p>	<p><b>The Authorized Representatives are:</b></p> <p><b>For the Procuring Agency:</b></p> <p>PMU HESCO (Hyderabad Electric Supply Company), Director General Procurement Project Management Unit Bungalow # A-1 HESCO Colony Hussainabad, Hyderabad. +92-337-219-2716 dgprocurement@hesco.gov.pk</p> <p><b>For the Bidder:</b></p> <p><b>Name:</b> .....</p> <p><b>Designation:</b> .....</p> <p><b>Address:</b> .....</p>
<p><b>GCC 8</b></p>	<p><b>Effectiveness of the contract</b></p>
<p><b>GCC 9</b></p>	<p><b>Commencement of Contract:</b></p>
<p><b>GCC 11.2</b></p>	<p><b>Expiration of Contract:</b></p>

<p><b>GCC 15</b></p>	<p><b>Termination</b></p> <p>In the event of termination of the contract due to any reason as already defined in the General Conditions of Contract, the Bidder shall be responsible for providing to the Authority the Goods till the time of alternate arrangements.</p>
<p><b>GCC 17</b></p>	<p><b>Conflict of Interest:</b></p> <p>The Procuring Agency reserves the right to determine on a case-by-case basis whether the Bidder should be disqualified from providing goods or services due to a conflict of a nature described in Clause GCC 17.</p>
<p><b>GCC 22</b></p>	<p><b>Liquidated Damages</b></p> <p>If the Bidder fails to provide services as required under the contract or in case of any data loss/data breach or any incident compromising the data security or other such failures related to any services, the Bidder shall pay to the Procuring Agency as Liquidated Damages at a rate of <b>0.06%</b> to <b>10.00%</b> of the Contract value, in accordance with the extent of performance failure &amp; the cost of investigating such incidents as judged by the Authority.</p>
<p><b>GCC 23</b></p>	<p><b>Performance Guarantee:</b></p> <p>The amount of performance guarantee shall be <b>10.00%</b> of the contract price in acceptable form of <b>Bank Guarantee</b></p>
<p><b>GCC 32</b></p>	<p><b>Payment terms:</b></p> <p>Payment will be made to the Bidder against the procured Goods and services according to the actual invoice or running bills submitted by the Bidder against the services provided within the time given in the conditions of the contract.</p>
<p><b>GCC 33</b></p>	<p><b>Currency of Payment:</b></p> <p>All the payment to be released to the contractor/Bidder shall be in Pakistani Rupees.</p>

**GCC 34****Identifying Defects:**

The Authority reserves the right at any time to inspect the premises of the provider to inspect the goods and monitor the goods being provided.

**Inspections & Tests Requirements**

For being Brand New, bearing relevant reference numbers of the equipment (Certificate from supplier)

For the Country of Origin as quoted by the Supplier (Certificate from manufacturer)

For conformance to specifications and performance parameters, through Prior to delivery inspection (Inspection Report by Procurement Committee / Inspection Team)

Two authorized representatives of Director General (Procurement) will carry out pre delivery inspection at manufacturer works at supplier expenses including travelling (return air tickets for places of inspection located out of Hyderabad), local transportation, boarding & lodging in any A class accommodation and daily allowance (including travel time), as per Govt. of Pakistan Policy. The said payment will be made to the inspectors before issuance of Inspection Certificate.

**Delivery & Documents**

Supplier's invoice in triplicate showing Goods' description, quantity, unit price, and total amount;

Delivery Challan duly acknowledged and signed by the consignee.

GRN issued by concerned Deputy Manager, Regional Store HESCO MCPL Workshop Jamshoro.

Warranty Certificate as per warranty clause.

Inspection Certificate as per inspection clause

Confirmation letter of acceptance of performance Bond/Security by the Manager (Procurement) PMU HESCO.

Certificate to the effect that the billed amount has not been claimed or received earlier (Non-payment certificate).

Professional Tax paid certificate by the firm (if applicable).

All Federal & Provincial Taxes will be applied as per prevailing laws.

Copy of General Sales Tax/Excise Duty Invoice.

The manufacturer/supplier in its invoices shall also give an undertaking, in case of omission of any deductible amount; HESCO's claim at any later stage (through pre-audit / post audit) shall be acceptable to them.

As per directions of FBR dated. 3.9.2015 conveyed vide C.E (Operation) PEPCO vide

**Following is the guidance for Dispute Resolution**

1. If any dispute of any kind whatsoever shall arise between the Authority and the Bidder in connection with or arising out of the Contract, including without prejudice to the generality of foregoing, any question regarding its existence, validity, termination and the execution of the Contract – whether during developing phase or after their completion and whether before or after the termination, abandonment or breach of the Contract – the parties shall seek to resolve any such dispute or difference by mutual diligent negotiations in good faith within 14 (fourteen) days following a notice sent by one Party to the other Party in this regard.
2. At future of negotiation the dispute shall be resolved through mediation and mediator shall be appointed with the mutual consent of the both parties.
3. At the event of failure of mediation to resolve the dispute relating to this contract such dispute shall finally be resolved through binding Arbitration by sole arbitrator in accordance with Arbitration Act 1940. The arbitrator shall be appointed by mutual consent of the both parties. The Arbitration shall take place in Islamabad, Pakistan and proceedings will be conducted in English language.
4. The cost of the mediation and arbitration shall be shared by the parties in equal proportion however the both parties shall bear their own costs and lawyer's fees regarding their own participation in the mediation and arbitration. However, the Arbitrator may make an award of costs upon the conclusion of the arbitration making any party to the dispute liable to pay the costs of another party to the dispute.
5. Arbitration proceedings as mentioned in the above clause regarding resolution of disputes may be commenced prior to, during or after completion of the contract.

Notwithstanding any reference to the arbitration herein, the parties shall continue to perform their respective obligations under the Contract unless they otherwise agree that the Authority shall pay the Bidder any monies due to the Bidder.

**Rules of procedure for arbitration proceedings:**

Any dispute between the Authority and a Bidder who is a national of the Islamic Republic of Pakistan arising in connection with the present Contract shall be referred to adjudication or arbitration in accordance with the laws of the Islamic Republic of Pakistan including Arbitration Act 1940, however above provision shall prevail in referring the case to the Arbitrator.

**Place of Arbitration and Award:**

The arbitration shall be conducted in English language and place of arbitration shall be at Islamabad. The award of the arbitrator shall be final and shall be binding on the parties.



Bid Securing Declaration

## Form 9: Bid Securing Declaration

Date: *[insert date (as day, month and year)]*

Bid No.: **P10577**

To: **PMU HESCO (Hyderabad Electric Supply Company), Director General Procurement Project Management Unit Bungalow # A-1 HESCO Colony Hussainabad, Hyderabad.**

We, the undersigned, declare that:

We understand that, according to your conditions, Bids must be supported by a Bid Securing Declaration.

We accept that we will be blacklisted and henceforth cross debarred for participating in respective category of public procurement proceedings for a period of (not more than) six months, if fail to abide with a bid securing declaration, however without indulging in corrupt and fraudulent practices, if we are in breach of our obligation(s) under the Bid conditions, because we:

1. have withdrawn or modified our Bid during the period of Bid Validity specified in the Form of Bid;
2. Disagreement to arithmetical correction made to the Bid price; or
3. having been notified of the acceptance of our Bid by the Procuring Agency during the period of Bid Validity, (i) failure to sign the contract if required by Procuring Agency to do so or (ii) fail or refuse to furnish the Performance Security or to comply with any other condition precedent to signing the contract specified in the Bidding Documents.

We understand this Bid Securing Declaration shall expire if we are not the successful

Bidder, upon the earlier of (i) our receipt of your notification to us of the name of the successful Bidder; or (ii) twenty-eight (28) days after the expiration of our Bid.



Contract Form

## SECTION IX: CONTRACT FORMS

THIS AGREEMENT made the \_\_\_\_\_ day of \_\_\_\_\_ 20\_\_\_\_ between **PMU HESCO (Hyderabad Electric Supply Company), Director General Procurement Project Management Unit Bungalow # A-1 HESCO Colony Hussainabad, Hyderabad.**

(hereinafter called “the Procuring Agency”) of the one part and [name of Bidder] of [city and country of Bidder] (hereinafter called “the Bidder”) of the other part:

WHEREAS the Procuring Agency invited Bids for provision of goods, viz., **Tender No. PMU 204/25-26 , Procurement of T&P and Testing Equipment (P10577)** and has accepted a Bids by the Bidder for the provision of Goods in the sum of [contract price in words and figures] (hereinafter called “the Contract Price”).

### NOW THIS CONTRACT WITNESSETH AS FOLLOWS:

1. In this Contract words and expressions shall have the same meanings as are respectively assigned to them in the Conditions of Contract referred to.

2. The following documents shall be deemed to form and be read and construed as part of this Contract, In the event of any ambiguity or conflict between the Contract Documents listed below, the order of precedence shall be the order in which the Contract Documents are listed below:-

1. This form of Contract;
2. the Form of Bids and the Price Schedule submitted by the Bidder;
3. the Schedule of Requirements;
4. the Technical Specifications;
5. the Special Conditions of Contract;
6. the General Conditions of the Contract;
7. the Procuring Agency’s Letter of Acceptance; and
8. [add here: any other documents]

3. In consideration of the payments to be made by the Procuring Agency to the Bidder as hereinafter mentioned, the Bidder hereby covenants with the Procuring Agency to provide the Goods related services and to remedy defects therein in conformity in all respects with the provisions of the Contract.

4. The Procuring Agency hereby covenants to pay the Bidder in consideration of the provision of Goods and the remedying of defects therein, the Contract Price or such other sum as may become payable under the provisions of the contract at the times and in the manner prescribed by the contract.

IN WITNESS whereof the parties hereto have caused this Contract to be executed in accordance with their respective laws the day and year first above written.

Signed, sealed, delivered by \_\_\_\_\_ the \_\_\_\_\_ (for the Procuring Agency)

Witness to the signatures of the Procuring Agency:

.....

Signed, sealed, delivered by \_\_\_\_\_ the \_\_\_\_\_ (for the Procuring Agency)

Witness to the signatures of the Bidder: .....





Integrity Pact

## Integrity Pact

### **DECLARATION OF FEES, COMMISSION AND BROKERAGE ETC. PAYABLE BY THE SUPPLIERS OF GOODS, SERVICES & WORKS IN CONTRACTS WORTH RS.10.00 MILLION OR MORE**

**Contract Number:** Contract Value: Contract Title:

Dated:

[Name of Supplier] hereby declares that it has not obtained or induced the procurement of any contract, right, interest, privilege or other obligation or benefit from Government of Pakistan or any administrative subdivision or agency thereof or any other entity owned or controlled by it (GoP) through any corrupt business practice.

Without limiting the generality of the foregoing [Name of Supplier] represents and warrants that it has fully declared the brokerage, commission, fee etc. paid or payable to anyone and not given or agreed to give and shall not give or agree to give to anyone within or outside Pakistan either directly or indirectly through any natural or juridical person, including its affiliate, agent, associate, broker, consultant, director, promoter, shareholder, sponsor or subsidiary, any commission, gratification, bribe, finder's fee or kickback, whether described as consultations fee or otherwise, with the object of obtaining or inducing the procurement of a contract, right, interest, privilege or other obligation or benefit in whatsoever form from GoP, except that which has been expressly declared pursuant hereto.

[Name of Supplier] certifies that it has made and will make full disclosure of all agreements and arrangements with all persons in respect of or related to the transaction with GoP and has not taken any action or will not take any action to circumvent the above declaration, representative or warranty.

[Name of Supplier] accepts full responsibility and strict liability for making and false declaration, not making full disclosure, misrepresenting fact or taking any action likely to defeat the purpose of this declaration, representation and warranty. It agrees that any contract, right interest, privilege or other obligation or benefit obtained or procured as aforesaid shall, without prejudice to any other right and remedies available to GoP under any law, contract or other instrument, be voidable at the option of GoP.

Notwithstanding any rights and remedies exercised by GoP in this regard, [Name of Supplier] agrees to indemnify GoP for any loss or damage incurred by it on account of its corrupt business practices and further pay compensation to GoP in an amount equivalent to ten times the sum of any commission, gratification, bribe, finder's fee or kickback given by [Name of Supplier] as aforesaid for the purpose of obtaining or inducing the procurement of any contract, right, interest, privilege or other obligation or benefit in whatsoever form from GoP.



## Performance Guarantee Form

# Performance Guarantee Form

To: **PMU HESCO (Hyderabad Electric Supply Company), Director General Procurement Project Management Unit Bungalow # A-1 HESCO Colony Hussainabad, Hyderabad.**

WHEREAS *[name of Bidder]* (hereinafter called “the Bidder”) has undertaken, in pursuance of Contract No. *[reference number of the contract]* dated *[insert date]* for provision of Goods (hereinafter called “the Contract”).

AND WHEREAS it has been stipulated by you in the said Contract that the Bidder shall furnish you with a Bank Guarantee by a reputable bank for the sum specified therein as security for compliance with the Bidder’s performance obligations in accordance with the Contract.

AND WHEREAS we have agreed to give the Bidders guarantee:

THEREFORE, WE hereby affirm that we are Guarantors and responsible to you, on behalf of the Bidder, up to a total of *[amount of the guarantee in words and figures]*, and we undertake to pay you, upon your first written demand declaring the Bidder to be in default under the Contract and without cavil or argument, any sum or sums within the limits of *[amount of guarantee]* as aforesaid, without your needing to prove or to show grounds or reasons for your demand or the sum specified therein.

This guarantee is valid until the: *[insert date]*

Signature and seal of the Guarantors

---

*[name of bank or financial institution]*

---

*[address]*

---

*[date]*



Annexure

## Technical Specifications/requirement

Bidder offer the material as per the specification/requirement attached.

Upload Technical Document

See Form Under Additional Forms and Documents: **Technical Specifications/requirement** (page number: 80)





## Procurement Forms

## Past Experience and Completed Contracts

### Contractual Experience.

Bidder/JV shall have successfully completed at least two (02) number of contracts of same nature/type. "Same nature/type" means material/equipment having comparable characteristics/ features same rating or higher rating not lower rating within last 07 years. In this context, complete set of copies of the contract agreements/Purchase Orders along-with copy of GRN/ completion certificate (must be issued by the end user client) for the equipment indicated in the supply record pertaining to the specified and comparable equipment during the bid evaluation. In this context the bidder is required to fill only in the relevant forms given in tender document and submit the same with the bid. Schedule of qualifications duly filled in should be submitted with the bid and extra sheets may be used to furnish qualifications, experience and supply record (year wise) of the addresses/contract numbers of the purchasers/clients.

### Manufacturing Experience.

The manufacturer shall demonstrate designing and manufacturing experience of similar or higher rated equipment /material for at least five year and Two-year satisfactory operation performance of offered equipment.

**Note:- For Lot - I,II, and III only.**

See Form Under Additional Forms and Documents: **Past Experience and Completed Contracts** (page number: 94)

## Historical Contract Non-Performance, and Pending Litigation and Litigation History

Bidders are requested to submit details of all litigation, arbitration and other claims whether pending, threatened or resolved in the last five years.

**Note:- For Lot - I,II, and III only.**

See Form Under Additional Forms and Documents: **Historical Contract Non-Performance, and Pending Litigation and Litigation History** (page number: 95)

## Financial Capacity and Net Worth Evaluation Form

The bidder should have sound financial health. In order to determine the same the bidder shall provide its up to date audited financial statements/ other financial statements acceptable to employer e. balance sheet, income statement, and cash flow statements for the last 3 years (three years). The bidder's Net worth for each last 3 years should be positive. In this context the bidder is required to fill in the relevant forms of this bidding document and submit the same with the bid.

A bidder/or all partners combined in case of JV has to have sufficient financing sources, liquid assets, unencumbered real assets, lines of credit, available to meet the total cash flow demands of the contract. The cash flow availability be at least 25% of the total quoted amount.

**Note:- For Lot - I,II, and III only.**


See Form Under Additional Forms and Documents: **Financial Capacity and Net Worth Evaluation Form** (page number: 97)

## Average Annual Turnover

The bidder shall have an average annual turnover in the last 3 years equal to or more than that of the quoted bid price. The annual turnover of partners in a JV shall be calculated by summing their individual turnovers. In case of JV, all JV partners shall combinedly meet the said requirement.

**Note:- For Lot - I,II, and III only.**

See Form Under Additional Forms and Documents: **Average Annual Turnover** (page number: 99)

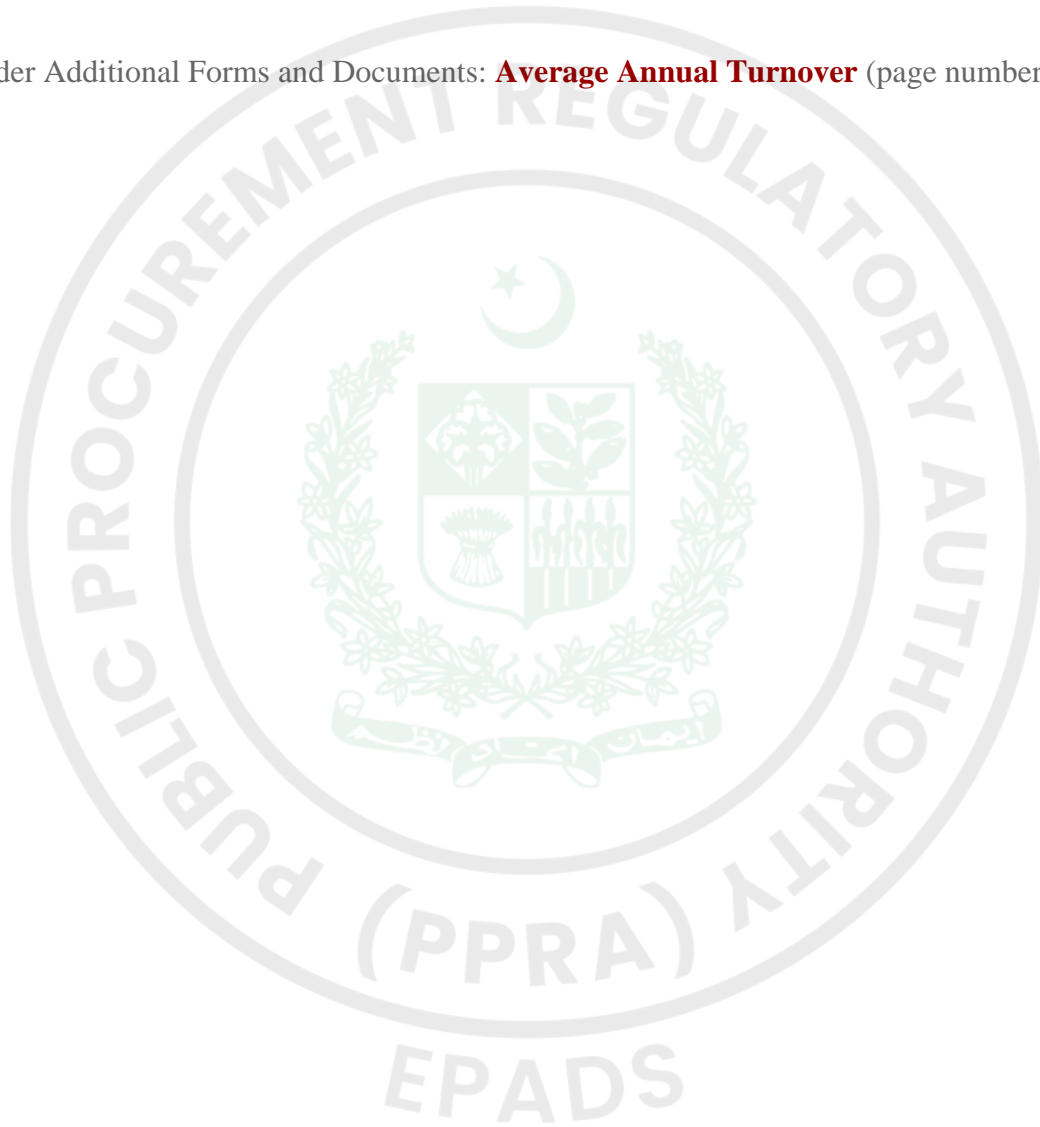





## Additional Forms and Documents

## 1. KEY SPECIFICATIONS TOTAL STATION

- **Accuracy:** 2" (iM-52), 3" (iM-55).
- **Telescope:** 30x Magnification, 2.5" Resolving Power, Erect Image, 45mm Aperture.
- **Measurement:** Reflectorless (Class 3R), Prism (Class 1), Fine/Rapid/Tracking modes.
- **Range:** Up to 4,000m with prism, ~500m reflectorless.
- **Display/Keyboard:** Dual Graphic LCD, Alphanumeric Keyboard, Backlit.
- **Data Storage:** 50,000 points internal, USB flash drive support (up to 32GB).
- **Durability:** IP66, -20°C to +60°C.
- **Battery:** Li-ion, long life



## 2. SPECIFICATION OF REAL-TIME KINEMATIC (RTK)

### PERFORMANCE SPECIFICATIONS

#### Satellite Signals Tracked Simultaneously

Channels.....	1024
GPS.....	L1, L2, L5
BeiDou.....	B1, B2, B3
GLONASS.....	L1, L2
Galileo.....	E1, E5A, E5B
QZSS.....	L1, L2, L5
SBAS.....	L1

#### Positioning Performance

##### High-precision static GNSS Surveying

Horizontal.....	2.5mm + 0.5ppm RMS
Vertical.....	5mm + 0.5ppm RMS

##### Real Time Kinematic (RTK)

###### Single Base

Horizontal.....	8mm+1ppm RMS
Vertical.....	15mm+1ppm RMS

###### Network RTK

Horizontal.....	8mm+0.5ppm RMS
Vertical.....	15mm+0.5ppm RMS
Initialization time.....	Typically 2-10s
Initialization reliability.....	Typically > 99.9%

#### Tilt Survey

##### Electronic Bubble

#### Communication

##### Internal UHF Radio

Frequency.....	403-473MHz
Channels.....	116 (16 adjustable)
Transmitting power.....	1W/2W/4W adjustable
Supports multiple protocols: HI-TARGET, TRIMTALK450S, TRIMMARK III, TRANSEOT, SATEL-3AS, etc.	
Working range.....	3-5km typical, 5-8km optimal

##### External UHF Radio

Frequency.....	410-470MHz
Channels.....	8
Transmitting power.....	5W/25W adjustable
Supports multiple protocols: TRIMTALK450S, TRIMMARK III, TRANSEOT	

#### Network Communication

Bluetooth.....	4.0/2.1+EDR, 2.4GHz
4G Network.....	TDD-LTE, FDD-LTE, WCDMA, EDGE, GPRS, GSM
Wi-Fi frequency.....	2.4GHz
Wi-Fi protocol.....	802.11b/g/n

#### Power Supply

##### Internal Battery

5000mAh lithium-ion rechargeable and removable battery  
RTK Rover (UHF/Cellular) for 10 hours

##### External Power

6-28V DC external power input (5-pin port) with over-charge protection  
Power consumption..... 4.2W

#### Physical

Dimensions(W×H).....	164mm×83.5mm
Weight.....	≤1.4kg (includes battery)
Data storage.....	8G internal storage

#### I/O Interface

- 1 × Mini USB port
- 1 × TNC antenna connector
- 1 × DC power input (5-pin)
- 1 × SIM card slot

#### Control Panel

Physical button.....	1
LED lamp.....	Satellite, Signal, Power

#### Environment

Water/Dustproof.....	IP67
Shock and vibration.....	Survive from 2m natural fall on to ground
Humidity.....	100% condensing
Operation temperature.....	-45°C ~ +75°C
Storage temperature.....	-55°C ~ +85°C

#### Data Formats

Output rate.....	1-20Hz
Static data format.....	GNS, Rinex
Network model.....	VRS, supports NTRIP protocol
Message type.....	CMR, RTCM 2.x, RTCM 3.0, RTCM 3.2
Navigation outputs ASCII.....	NMEA-0183

# CT/PT Analyzer Test Set

## 1. General Description

The CT/PT Analyzer Test Set is a microprocessor-based multifunction testing instrument designed for automatic testing and evaluation of current transformers (CTs) and potential transformers (PTs) used in substations and protection systems. It performs excitation, ratio, polarity, burden, phase angle, and error tests in accordance with international standards such as IEC 60044, IEC 61869, and IEEE C57.13.

## 2. Technical Specifications

Parameter	Specification
Power Supply	AC 100–240 V, 50/60 Hz
Applicable Standards	IEC 60044, IEC 61869, IEEE C57.13
Test Methods	Excitation, Ratio, Polarity, Phase Angle, Burden, Knee Point
CT Excitation Voltage Output	0 – 2000 V AC or 0 – 1200 V RMS (auto adjustable)
CT Excitation Current Output	Up to 20 A (auto range)
PT Test Voltage Output	Up to 120 V AC
Measurement Accuracy (Ratio)	±0.1%
Phase Angle Accuracy	±1 min or better
Knee Point Determination	Automatic (IEC 60044-1 compliance)
Burden Measurement Range	0 – 300 VA
Excitation Curve Plotting	Automatic with data storage
Polarity Check	Automatic detection
Data Storage	≥ 500 test results internal memory
Interface	USB / RS232 / LAN for PC data transfer
Software	PC analysis software for report generation
Enclosure Protection	IP 54 or better
Weight	≤ 15 kg

## 3. Functional Features

- Fully automatic testing of CT and PT parameters with minimal manual connection.
- Performs CT excitation curve plotting and determines knee point voltage & current.
- Measures ratio, phase angle error, polarity, burden, and magnetization characteristics.
- Tests both protection and metering class CTs (5P, 10P, PX, PS, etc.).
- Capable of PT voltage ratio and polarity measurement with accuracy.
- Real-time graphical display of excitation and phase curves.
- Internal database for result storage and automatic report generation.
- Battery or mains powered for field portability.
- USB or LAN connectivity for test result downloads to PC.
- Compatible with external printer for direct report printing.

#### 4. Accessories

- High-voltage and low-voltage test leads with safety connectors
- Current and voltage measurement cables
- Power cable (AC 100–240 V)
- USB data cable
- Calibration certificate
- PC software and user manual
- Carrying case with foam padding
- Optional: external printer and clamp CT adapter

#### 5. Safety & Protection

- Overvoltage and overcurrent protection on all outputs
- Automatic discharge of CT secondary after excitation test
- Interlock protection to prevent incorrect connections
- Over-temperature and short-circuit protection
- Complies with IEC 61010-1 safety requirements
- Emergency stop and grounding terminal provided

#### 6. Applications

- Type testing and routine testing of CTs and PTs in substations
- Testing during **commissioning, maintenance, or fault analysis**
- Verification of **CT/PT ratio, polarity, and burden** in protection panels
- Field testing of instrument transformers in **132 kV Grid station**
- Calibration and performance verification for **protection relays and metering systems**

# Three-Phase TTR (Transformer Turns Ratio) Test Set

## 1. General Description

The Three-Phase Transformer Turns Ratio (TTR) Test Set is a digital microprocessor-controlled instrument designed to measure the turns ratio, phase angle deviation, and polarity of power, distribution, and instrument transformers. It performs automatic ratio and phase measurement across all three phases simultaneously, significantly reducing testing time compared to single-phase testers.

## 2. Technical Specifications

Parameter	Specification
Test Object	Three-Phase Power, Distribution, and Instrument Transformers
Standards Compliance	IEC 60076, IEEE C57.12.90, IEC 61010-1
Measurement Range (Turns Ratio)	1:100,000 or better
Measurement Accuracy	±0.1% of reading
Phase Angle Measurement Range	0° – 360°
Phase Angle Accuracy	±0.1°
Excitation Voltage Output	0 – 250 V AC (phase selectable, auto adjustable)
Excitation Frequency	50/60 Hz
Measurement Time	< 10 seconds (for all three phases)
Polarity Indication	Automatic (additive/subtractive)
Vector Group Detection	Automatic (supports all IEC/ANSI vector groups)
Magnetizing Current Measurement	0 – 2 A
Voltage Ratio Display	Primary / Secondary (phase-wise)
Display	7" or larger color LCD / touchscreen
Data Storage	≥ 1000 test results internal memory
Communication Interface	USB / RS232 / LAN for data transfer
Software	PC software for report generation and vector diagram display
Power Supply	AC 100–240 V, 50/60 Hz
Operating Temperature	–10°C to +60°C
Storage Temperature	–20°C to +60°C
Enclosure Protection	IP54 (dust and splash resistant)
Dimensions (Approx.)	400 × 300 × 180 mm
Weight	≤15 kg
Safety Compliance	IEC 61010-1 (Measurement and Laboratory Equipment Safety)

### 3. Functional Features

- Simultaneous testing of all three phases (ABC) with automatic vector group detection.
- Measures turns ratio, phase deviation, polarity, magnetizing current, and excitation voltage.
- Compatible with star, delta, zigzag, and other winding connections.
- Automatic calculation of deviation from nominal ratio for each phase.
- Built-in database and report generator for quick result printing.
- On-screen vector diagram display showing actual phase relationships.
- Supports manual or automatic test modes.
- Quick connection via color-coded test leads for high accuracy and safety.
- Rugged design for field use at substations and manufacturing sites.

### 4. Accessories

- Three-phase test lead set with quick-connect clips
- Grounding cable and power cord
- USB cable for PC data transfer
- Software and driver CD
- Calibration certificate traceable to international standards
- Printed operation and safety manual
- Carrying and transport case (shockproof, waterproof)
- Optional: external printer and 15 m extended cable set

### 5. Safety & Protection

- Overvoltage and overcurrent protection on all test channels
- Automatic discharge of transformer windings after test
- Interlock safety feature for incorrect connections
- Short-circuit protection and emergency shutdown
- Conforms to IEC 61010-1 electrical safety standards
- Over-temperature protection and grounding interlock provided

### 6. Applications

- Routine and type testing of power and distribution transformers
- Commissioning and maintenance testing in 132 kV grid stations
- Verification of vector group, ratio, and polarity before energization
- Quality control during transformer manufacturing or repair
- Detection of winding connection errors, shorted turns, or phase faults
- Testing instrument transformers (CT/PT) for correct ratio and phase angle

## DC Hi-Pot Test Set 120kV DC

Parameter	Specification
Model class	Portable / field or two-box design delivering DC 0-120 kV
Maximum output voltage	0 – 120 kV DC, continuously variable
Maximum output current / ranges	Selectable ranges: 2 mA, 3 mA, 5 mA, 10 mA (typical options); continuous and short-duration ratings must be stated.
Voltage accuracy / resolution	Voltage accuracy $\pm(1\%$ of reading $\pm 1$ digit) typical; resolution $\leq 0.1$ kV (or 1 V in lower ranges)
Current accuracy / resolution	Current accuracy $\pm(1\%$ reading $\pm 1$ digit); leakage measurement down to $0.1 \mu\text{A}$ — $1 \mu\text{A}$ resolution depending on model
Voltage stability / regulation	$\leq 1\%$ change for mains $\pm 10\%$
Ripple / DC quality	Ripple factor $<0.5\%$ (where specified)
Polarity	Selectable polarity (positive/negative) and no-voltage / zero-start safety interlock
Ramp & timing	Programmable ramp up/down, dwell time and test duration (e.g., 1 s – 99 h) with segmented timing
Protection / trip functions	Overcurrent trip, overvoltage trip, earth/ground detection, arcing/breakdown detection, automatic shut-down on fault
Discharge	Built-in resistive discharge network and automatic discharge relay; discharge time $< 5$ s
Metering & display	Digital display (voltage, current, time); some analog/dedicated metering on legacy models; optional graphic touchscreen on advanced models
Data & communications	USB & RS-232 / optional Ethernet or Bluetooth; internal logging (N records) and PC software for reports
Power supply	AC mains: 230 V $\pm 10\%$ 50/60 Hz (115 V option on some units)
Cooling	Natural convection for small units; forced-air cooling for higher power continuous duty units
Mechanical / portability	Single-box or two-box design; control console + HV tank/transformer in separate oil-filled tank for 120 kV designs; transport case / wheels optional
HV output & accessories	Shielded HV cable(s), insulated output clamp, earth lead ( $\geq 3$ m typical), pressure-doubling cylinder (if used for compact sets)
Safety features	Zero-start interlock, safety earth check, E-STOP, HV ON indicators, audible alarm, case interlock
Environmental / operating	Operating: $-10$ °C to $+50$ °C (vendor to confirm); Relative humidity up to 95% non-condensing typical
Standards / compliance	IEC 60060-1 (high voltage test methods), IEC 61010-1 (safety), CE / EMC where applicable; calibration traceable to national standards
Typical weight / dimensions	Varies widely: lightweight modules (control box $\sim 10$ - $20$ kg + HV tank, typically 40cm x 30cm x 30cm)
Optional features	PD detection interfaces, combo AC/DC sets, larger current modules (up to 10 mA), touchscreens, printer, extended HV cable lengths, calibration certificate

## 80 kV AC Hi-Pot Test Set

### 1. General

Portable AC high-potential (Hi-Pot) test set for dielectric/insulation testing of equipment rated up to 132 kV, providing reliable AC test voltages up to 80 kV for both field and laboratory applications.

### 2. Technical Specification (80 kV Version)

Parameter	Specification
Output Voltage Range	1 kV – 80 kV AC (continuously variable)
Maximum Output Current	50–100 mA (selectable / limited)
Voltage Resolution	0.1 kV (or better)
Current Measurement Resolution	0.1 $\mu$ A
Output Type	AC sinusoidal, 50 / 60 Hz selectable
Frequency	50 / 60 Hz
Metering / Display	Digital display (Voltage, Current $\mu$ A, Test time, Pass/Fail)
Data Interface	USB standard + optional Ethernet/Bluetooth
Power Supply	230 V AC $\pm$ 10%, 50 Hz (115 V optional)
Cooling	Forced-air cooling with thermal control
Operating Temperature	-10 °C to +60 °C
Protection / Safety	Emergency stop, interlocks, overcurrent, overvoltage, overtemperature, earth-fault
Alarms	Audible and visual alarms (HV ON, Fault)
Enclosure	Rugged portable case with wheels & handles
Standards	IEC 60060-1 / IEC 61010-1 / IEEE 510
Accessories (Standard)	HV cable set, grounding cable, interlock lead, power cable, USB cable, manual, carrying case
Optional Accessories	PC software, remote control pendant, long HV leads, calibration certificate
Weight & Dimensions	$\leq$ 60 kg; compact portable chassis

### 3. Functional Features

- Continuous and stable AC output up to 80 kV with programmable ramp profiles.
- Real-time leakage current and voltage monitoring with data logging.
- Enhanced operator safety via interlocks and emergency trip systems.
- USB data export and optional PC software for reporting.

# Battery Capacity Tester

## 1. General Features

Portable automatic battery discharge test set for testing and analyzing 110V DC battery banks (130–150 Ah). Suitable for substation, power plant, and industrial battery systems. Provides real-time monitoring and recording of discharge parameters. Compact and rugged design with cooling and protection systems. Operates on 220V AC, 50 Hz power supply. Built-in charger Model: DR150V, Make: BATTERY. Complies with relevant IEC and international testing standards.

## 2. Electrical Specifications

Discharge Current Range	0–130 A
Current Accuracy	±1%
Battery Voltage Range	0–300 V DC
Voltage Accuracy	±1%
Supported Battery Type	110 V DC, 130–150 Ah (Lead-acid / Ni-Cd)
Input Power	220 V AC, 50 Hz
Discharge Mode	Constant Current / Constant Power
Protection	Thermal protection and polarity reversal
Internal Memory	Built-in for test data storage

## 3. Measurement & Display Parameters

Displayed data shall include discharge current, Ah discharged, test duration, battery voltage and time. Graphical display must show real-time discharge curve and selectable load patterns. Measurement recording shall be automatic with timestamps and reviewable on-screen or via PC software; data export in PDF, Excel or CSV formats.

## 4. Testing Capabilities

Performs both constant current and constant power discharge tests. Measures and records battery voltage drop, discharge current, ampere-hour capacity, discharge time and load profile. Automatic stop at preset voltage or time limits. Provides comprehensive performance analysis and report generation.

## 5. Safety and Protection

Thermal overload protection and reverse polarity protection with automatic cutoff on abnormal conditions. Built-in cooling system for extended duration testing.

## 6. Standards Compliance


IEC 61010-1 (Safety Requirements for Electrical Equipment); IEC 61326 (EMC Compliance); ISO 9001 quality management.

## 7. Accessories

Battery discharge cables with appropriate connectors, power cord and grounding cable, PC connection cable and software, heavy-duty carrying/case, and instruction/operation manual.

**Technical Specification Sheet**  
**Wooden Slippers**

1. Slippers should be Pine wood
2. Slippers should be dried to prevent bending of wood
3. Dimensions of wooden slippers be within range of
  - I. Length: 13.5 Inch
  - II. Width: 08 Inch
  - III. Height: 5.5 Inch

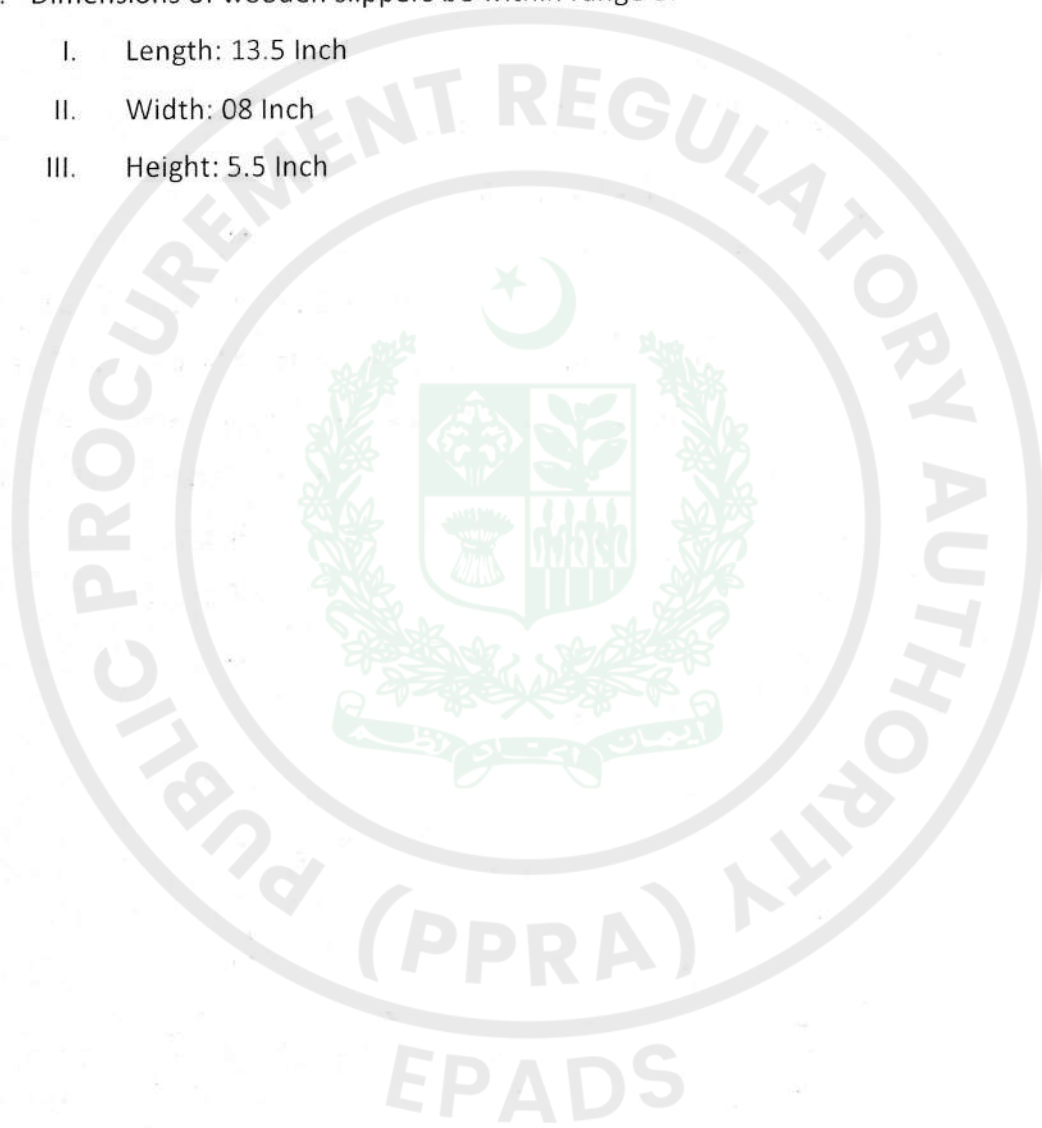

## Technical Specification Sheet

### 132KV Portable Grounding Set

A 132kV portable grounding set (or earthing set) is essential safety equipment used to temporarily ground de-energized high-voltage conductors or equipment in substations and on transmission lines. Its primary purpose is to protect personnel by ensuring the line or equipment remains at zero potential, primarily by dissipating stored energy, draining induced voltages, and conducting any accidental or back-fed fault current to the earth.

Parameter	Specification / Detail
Rated Voltage	132 kV (for use on systems with a highest voltage of 145 kV)
Application	High-voltage overhead line conductors, busbars, and switchgear terminals.
System Earthing	Suitable for Effectively Earthed systems.
Safety Purpose	To create an Equipotential Zone (EPZ) around the work area, preventing hazardous differences in electric potential.
Operating Standards	Must conform to relevant international safety and equipment standards, such as IEEE 80 (Substation Grounding), ASTM F855, and IEC 60855 / 61230 (Insulating/Grounding equipment).
Rated Short-Circuit Current	31.5 kA to 40 kA (RMS)
Short-Circuit Duration	3 seconds (or as specified)
Conductor Ampacity	Grounding leads must have an ampacity capable of conducting the maximum fault current. Common minimum for EHV is often $\geq 120 \text{ mm}^2$ stranded copper cable.
Impulse Withstand Voltage (Live-End Clamp)	Minimum of 650 kV Peak (1.2/50 $\mu$ s)
Phase / Live-End Clamps	Designed for round or flat busbars and various conductor diameters (e.g., up to 60 mm). Features robust serrated jaws for secure, low-resistance connection.
Ground-End Clamp	Designed for attachment to the substation earth mat, ground rod, or structure. Must ensure a quick, secure, and permanent connection.
Grounding Conductors (Leads)	Highly flexible, transparent/clear sheathed, extra-flexible copper cable (e.g., 120 mm <sup>2</sup> to 150 mm <sup>2</sup> ). Lengths vary (e.g., 5 m to 20 m), rated for the 40 kA fault current.
Operating (Hot) Stick	Telescopic or sectional insulating rod. Must be rated for the full system voltage (145 kV).
Junction Terminal (Optional)	A common terminal, usually a triangular plate, where multiple phase leads converge before connecting to a single earth lead.
Connectors/Ferrules	Leads must be compression-cripped to clamps using high-quality terminals or ferrules, often exothermic welded to eliminate weak points.

## Technical Specifications

### Manual Hydraulic Conductor Cutter

Parameter	Specification / Typical Range
Max Cutting Capacity (Conductor)	600 mm <sup>2</sup> to 800 mm <sup>2</sup> (Copper/Aluminium)
Max Cutting Diameter	≈40 mm to 55 mm (Overall Cable)
Maximum Cutting Force	45 kN to 88 kN (4.5 Tonnes to 9 Tonnes)
Operating Pressure	700 bar (10,000 PSI)
Pump Action	Double Speed Action (or Two-Stage Pump)
Blade Material	High-strength forged or chrome-vanadium tool steel
Cut Quality	Clean, crush-free cut
Tool Type	Hand Hydraulic Cutter (Integral Pump)
Head Design	Flip-Top / Open Head
Head Rotation	180° to 360° Swivel
Hydraulic Fluid	Mineral Oil or equivalent
Safety Features	Automatic Safety Valve
Weight	≈4 kg to 7 kg
Dimensions (Length)	≈500 mm to 650 mm
Handle/Grip	Ergonomic, non-slip handles (e.g., rubberized or PVC).

#### Operational and Ergonomic Features

- **Head Design:** Features a Flip-Top or Open Head (often pivots 90 degree or more) that allows the operator to easily insert running cables (cables already laid in a trench or on a tray) without needing to thread the cable through.
- **Head Rotation:** The head can typically rotate 180° to 360° relative to the handles, allowing the operator to position the tool optimally for comfort and leverage in confined spaces.
- **Portability:** Designed to be lightweight for a high-capacity tool (typically 4 kg to 7kg), allowing for comfortable two-handed operation and easy transport in a carrying case.
- **Operation:** Cutting is achieved by repeatedly pumping the operating handle. The cut is released by operating a pressure release device or release lever on the handle, which retracts the blade.

#### Safety and Limitations

- **Safety Valve:** Includes an Automatic Safety Valve that protects the tool by bypassing the hydraulic fluid once the maximum safe working pressure (Approx. 700 bar) or maximum force is reached.
- **Blade Stop:** The cut can generally be interrupted and the blade retracted at any point during the cutting cycle by engaging the release mechanism.
- **Non-Insulated:** Crucially, this tool is typically NOT insulated. The operator must never use the cutter on or near energized electrical lines. Proper personal protective equipment (PPE) and confirmation that the cable is de-energized are mandatory.

## Technical Specifications

### 5KVA Portable Generator

Feature	Specification
Output	5 kVA (Apparent Power) / 4 kW (Rated Power Factor of 0.8)
Engine Type	Single cylinder, 4-stroke, air-cooled diesel or petrol engine
Engine Speed	Typically 3000 RPM (for 50 Hz frequency)
Fuel Type	Diesel (e.g., HSD-ASTM D2) or Petrol/Gasoline
Fuel Tank Capacity	15–16 Liters (approx. 7–8 hours continuous running at 75% load)
Fuel Consumption	Approx. 1.5–2.0 LPH (Liters Per Hour) at 75-100% load
Alternator	Brushless, self-excited, Class H insulation
Rated Current (Amps)	approx 17.4 (at 230 V, 0.8 PF)
Voltage Regulation	Automatic Voltage Regulator (AVR) or Capacitor regulated (+/- 5% to +/- 10% regulation)
Control Panel	Features voltmeter, ammeter, frequency meter, hour meter, and AC output sockets
Dimensions (L x W x H)	Approx. 900 x 550 x 750 mm (varies by model)
Weight (Dry)	Approx. 150–200 kg (varies, especially for silent/enclosed units)
Starting System	Electric Start (12V DC) and/or Recoil (Pull Cord)
Noise Level	68 dBA to 75 dBA at 7 meters
Insulation Class	Class F or Class H
Control Panel	Includes MCB/Circuit Breaker (for overload protection), output sockets (e.g. 16 A or 32A), and instrumentation (Voltmeter, Hour Meter).

EPADS

## Technical Specification Sheet


### Hydraulic Press machine – 100 Ton Capacity

<b>Parameter</b>	<b>Specification / Detail</b>
Rated Pressing Force / Capacity	100 tons (100 t)
Maximum Working Pressure	700 bar
Max Stroke	26 mm
Maximum Hexagonal Key Size	57 mm
Weight-to-Power Ratio	3.1 ton per kg
Press Weight	32 kg
Die / Tool Weight (Typical)	~1.5 kg
Operation / Drive Mechanism	Hydraulic
Application / Use Case	Compression of joints on conductors and steel ropes (e.g., medium/high-voltage electrical line work).
Portability / Handling	Ultra-light press design (32 kg) — suitable for working on suspension platforms, towers, and field deployment.
Case / Packing Dimensions	50×70×62 cm

## Past Experience / Contracts

Contracts over *[insert amount]* during the last three years:

Procuring Agency	Value	Year	Goods/Services Supplied	Country of Destination

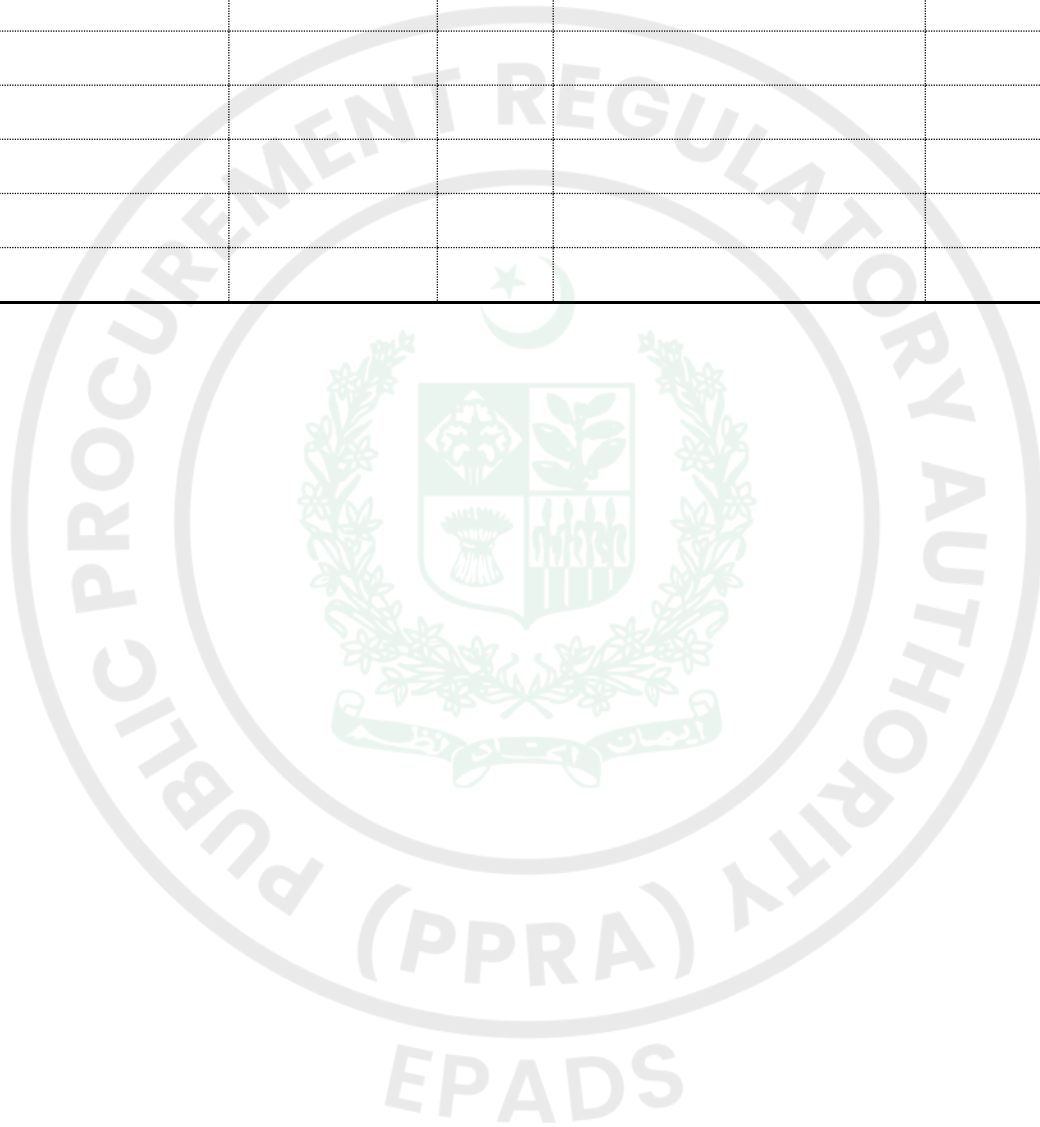

## Historical Contract Non-Performance, and Pending Litigation and Litigation History

*[The following table shall be filled in for the Applicant and for each member of a Joint Venture]*

Applicant's Name: *[insert full name]*

Date: *[insert day, month, year]*

Joint Venture Member Name: *[insert full name]*

IFP No. and title: *[insert IFP number and title]*

Page *[insert page number]* of *[insert total number]* pages

<input type="checkbox"/> Not debarred due to deviation from commitment of Bid Securing Declaration- <input type="checkbox"/> Not debarred due to non-performance			
Year	Non-performed portion of contract	Contract Identification	Total Contract Amount (current value, currency, exchange rate and PKR equivalent)
<i>[insert year]</i>	<i>[insert amount and percentage]</i>	Contract Identification: <i>[indicate complete contract name/ number, and any other identification]</i> Name of Procuring Agency: <i>[insert full name]</i> Address of Procuring Agency: <i>[insert street/city/country]</i> Reason(s) for nonperformance: <i>[indicate main reason(s)]</i>	<i>[insert amount]</i>
Pending Litigation, in accordance with Section III, Qualification Criteria and Requirements			
<input type="checkbox"/> Pending litigation in accordance with Section III, Qualification Criteria and Requirements, Sub-Factor 2.3 as indicated below.			
Year of dispute	Amount in dispute (currency)	Contract Identification	Total Contract Amount (currency), US\$ PKR Equivalent (exchange rate)

<i>[insert year]</i>	<i>[insert amount]</i>	Contract Identification: [indicate complete contract name, number, and any other identification] Name of Procuring Agency: <i>[insert full name]</i> Address of Procuring Agency: <i>[insert street/city/country]</i> Matter in dispute: <i>[indicate main issues in dispute]</i> Party who initiated the dispute: <i>[indicate "Procuring Agency" or "Supplier"]</i>  Status of dispute: <i>[Indicate if it is being treated by the Adjudicator, under Arbitration or being dealt with by the Judiciary]</i>	<i>[insert amount]</i>
<input type="checkbox"/> No consistent history of court/arbitral award decisions in accordance with Section III, Qualification Criteria and Requirements, Sub-Factor 2.4. <input type="checkbox"/> Consistent history of court/arbitral award decisions in accordance with Section III, Qualification Criteria and Requirements, Sub-Factor 2.4 as indicated below.			
<b>Year of award</b>	<b>Outcome as percentage of Net Worth</b>	<b>Contract Identification</b>	<b>Total Contract Amount (currency), PKR Equivalent (exchange rate)</b>
<i>[insert year]</i>	<i>[insert percentage]</i>	Contract Identification: [indicate complete contract name, number, and any other identification] Name of Procuring Agency: <i>[insert full name]</i> Address of Procuring Agency: <i>[insert street/city/country]</i> Matter in dispute: <i>[indicate main issues in dispute]</i> Party who initiated the dispute: <i>[indicate "Procuring Agency" or "Supplier"]</i> Court/ arbitral award decision: <i>[Indicate if the award decision was against the Applicant or any member of a joint venture.]y]</i>	<i>[insert amount]</i>

## Financial Situation and Performance

*[The following table shall be filled in for the Applicant and for each member of a Joint Venture]*

Applicant's Name: *[insert full name]*

Date: *[insert day, month, year]*

Joint Venture Member Name: *[insert full name]*

IFP No. and title: *[insert IFP number and title]*

Page *[insert page number]* of *[insert total number]* pages

### 1. Financial data

Type of Financial information in (currency)	Historic information for previous <i>[insert number]</i> years, <i>[insert in words]</i> (amount in currency, currency, exchange rate*, PKR equivalent)				
	Year 1	Year 2	Year 3		
Statement of Financial Position (Information from Balance Sheet)					
Total Assets (TA)					
Total Liabilities (TL)					
Total Equity/Net Worth (NW)					
Current Assets (CA)					
Current Liabilities (CL)					
Working Capital (WC)					
Information from Income Statement					
Total Revenue (TR)					
Profits Before Taxes (PBT)					
Cash Flow Information					
Cash Flow from Operating Activities					

\* Refer ITA 14 for the exchange rate

### 3. Financial documents

The Applicant and in case of JV, members of JV shall provide copies of financial statements for *[number]* years pursuant Section III, Qualifications Criteria and Requirements. The financial statements shall:

- (a) reflect the financial situation of the Applicant or in case of JV member, and not an affiliated entity (such as parent company or group member).
  - (b) be independently audited or certified in accordance with local legislation.
  - (c) be complete, including all notes to the financial statements.
  - (d) correspond to accounting periods already completed and audited.
- Attached are copies of financial statements<sup>1</sup> for the *[number]* years required above; and complying with the requirements.

---

<sup>1</sup> If the most recent set of financial statements is for a period earlier than 12 months from the date of Application, the reason for this should be justified.

## Average Annual Turnover (Annual Sales Value)

*[The following table shall be filled in for the Applicant and for each member of a Joint Venture]*

Applicant's Name: *[insert full name]*

Date: *[insert day, month, year]*

Joint Venture Member Name: *[insert full name]*

IFP No. and title: *[insert IFP number and title]*

Page *[insert page number]* of *[insert total number]* pages

<b>Annual Turnover Data</b>			
<b>Year</b>	<b>Amount Currency</b>	<b>Exchange rate* (If applicable)</b>	<b>PKR equivalent</b>
<i>[indicate calendar year]</i>	<i>[insert amount and indicate currency]</i>		
		Average Annual Turnover **	

\* Refer ITA for date and source of exchange rate.

\*\* Total PKR equivalent for all years divided by the total number of years. See Section III, Qualification Criteria and Requirements, ITA.